


REVISIONS	
REV	OR/WHICH
A	RELEASE

NOTES: (UNLESS OTHERWISE SPECIFIED)

1. THE MAXIMUM OUTPUT VOLTAGE FROM THE SAFE AREA APPARATUS MUST NOT EXCEED THE RATED VOLTAGE OF THE TRANSMITTER: 30VDC.
2. CIRCUIT IN HAZARDOUS AREA MUST BE CAPABLE OF WITHSTANDING A VOLTAGE TEST OF 500 VRMS TO EARTH.
3. THE INSTALLATION MUST COMPLY WITH THE APPROPRIATE NATIONAL INSTALLATION REQUIREMENTS.

DIVISION 2/ZONE 2 INSTALLATION

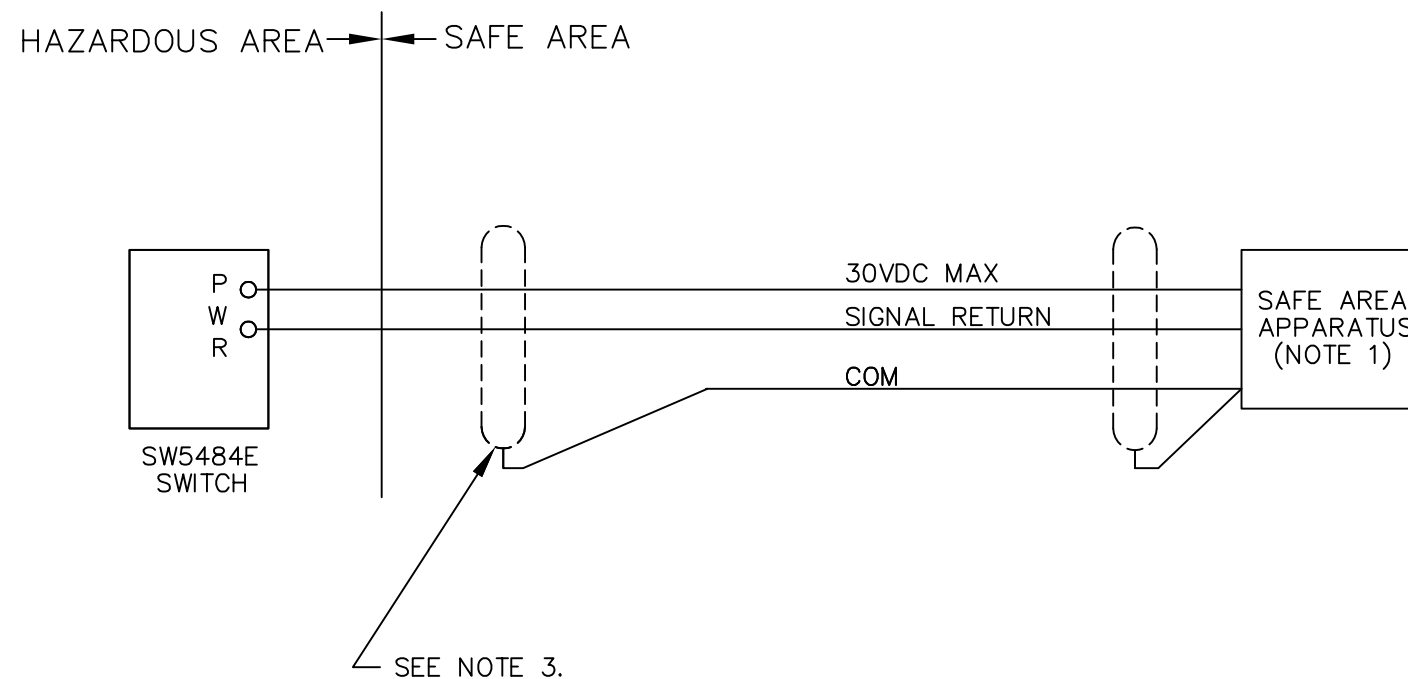

AGENCY APPROVED PRODUCT
DO NOT DEVIATE FROM
DOCUMENTED CONSTRUCTION
OR LISTED PARTS

Verifie' et Certfie'
conforme a' l'execution

MATERIAL:	UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. ALL CORNERS BROKEN TO .010 MIN RADIUS AND TOLERANCES ARE:		APPROVALS	DATE	METRIX HOUSTON, TEXAS USA
FINISH:	FRACTIONS: DECIMALS: ±1/64 .XX ±.01 ANGLES: .XXX ±.005 ±1" SURFACE FINISH 64		DRAWN BY: A. Wilson	04-15-20	
THIS DOCUMENT AND ALL INFORMATION HEREON IS THE PROPERTY OF METRIX INSTRUMENT CO. APPROVAL MUST BE OBTAINED BEFORE IT IS REPRODUCED OR INFORMATION HEREON IS ISSUED TO A THIRD PARTY. THIS DOCUMENT MUST BE RETURNED UPON REQUEST.			CHECKED BY:		INSTALLATION, SW5484E, INCREASED SAFETY
			APPROVED BY:		
					DRAWING NO. 1871697
					REV. A
					SHEET: 1 of 1