


NOTES: (UNLESS OTHERWISE SPECIFIED)

1. THE MAXIMUM OUTPUT VOLTAGE FROM THE SAFE AREA APPARATUS MUST NOT EXCEED THE RATED VOLTAGE OF THE TRANSMITTER: 30VDC.
2. CIRCUIT IN HAZARDOUS AREA MUST BE CAPABLE OF WITHSTANDING A VOLTAGE TEST OF 500 VRMS TO EARTH.
3. THE INSTALLATION MUST COMPLY WITH THE APPROPRIATE NATIONAL INSTALLATION REQUIREMENTS.

DIVISION 2/ZONE 2 INSTALLATION

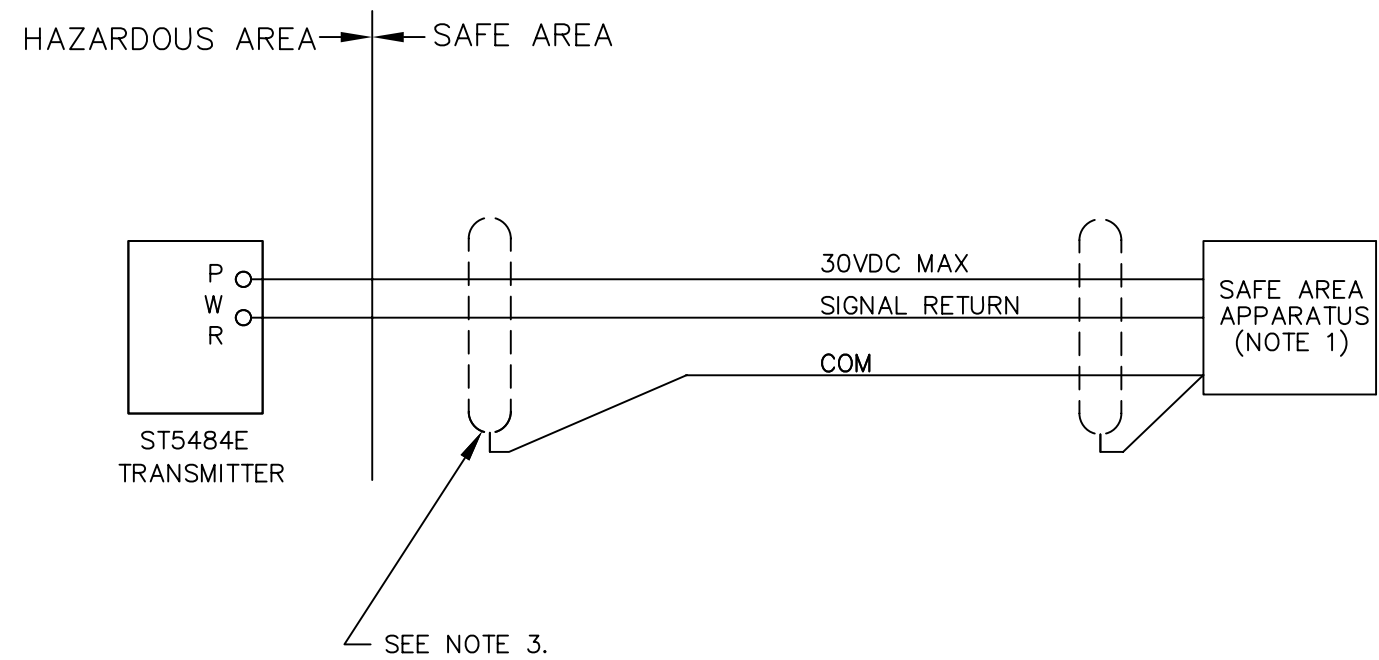

AGENCY APPROVED PRODUCT
DO NOT DEVIATE FROM
DOCUMENTED CONSTRUCTION
OR LISTED PARTS

Verifie' et Certfie'
conforme a' l'execution

MATERIAL:	UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES. ALL CORNERS BROKEN TO .010 MIN RADIUS AND TOLERANCES ARE:		APPROVALS	DATE	METRIX HOUSTON, TEXAS U.S.A. INSTALLATION ST5484E-XXX TRANSMITTER DRAWING NO. 1086105 REV. A
FINISH:			DRAWN BY:	07-01-11	
THIS DOCUMENT AND ALL INFORMATION HEREON IS THE PROPERTY OF METRIX INSTRUMENT CO. APPROVAL MUST BE OBTAINED BEFORE IT IS REPRODUCED OR INFORMATION HEREON IS ISSUED TO A THIRD PARTY. THIS DOCUMENT MUST BE RETURNED UPON REQUEST.	FRACTIONS: DECIMALS: ±1/64 .XX ±.01 ANGLES: ±1° SURFACE FINISH 64 ✓		CHECKED BY:	A. Wilson	
			APPROVED BY:		
		NEXT ASSY USED ON	ST5484E		SCALE: NONE
		APPLICATION	DO NOT SCALE DRAWING		SHEET: 1 of 1