


# **MODEL AM3030 ALARM MONITOR**

Installation Manual M9610

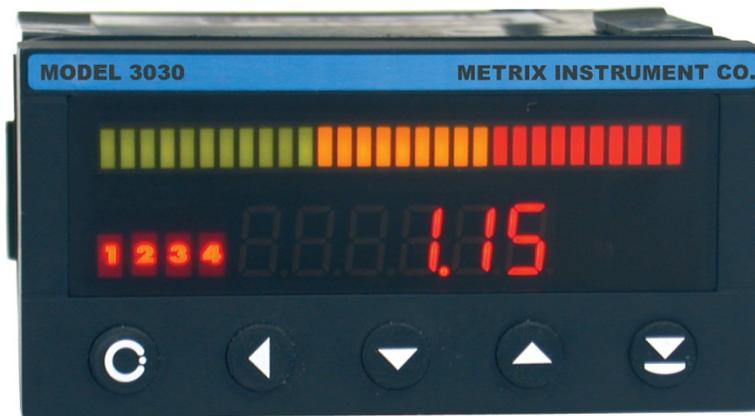

8824 Fallbrook Dr.  
Houston, TX 77064, USA

Tel: 1.281.940.1802

After Hours Technical Assistance: 1.713.702.8805

Fax: 1.713.559.9421

E-mail: [info@metrixsepoint.com](mailto:info@metrixsepoint.com)

[www.metrixsepoint.com](http://www.metrixsepoint.com)

**METRIX**  
Experience Value

## **SAFETY INSTRUCTIONS**

Please, read the enclosed safety instructions carefully and observe them!  
These instruments should be safeguarded by isolated or common fuses (breakers)!  
For safety information the EN 61 010-1 + A2 standard must be observed.

This instrument is not explosion-safe!

## **CONNECTION**

Supply of energy from the main line has to be isolated from the measuring leads.

1. Contents	3
2. Instrument description	4
3. Instrument connection	6
4. Instrument setting	8
Symbols used in the instructions	10
Setting the DP and the (-) sign	10
Control keys function	11
Setting/permitting items into "USER" menu	11
5. Setting "LIGHT" menu	12
5.0 Description "LIGHT" menu	12
Setting input - Type "DC"	16
Setting input - Type "PM"	18
Setting input - Type "DU"	20
Setting input - Type "OHM"	22
Setting input - Type "RTD - Pt"	24
Setting input - Type "RTD - Ni"	26
Setting input - Type "T/C"	28
Setting Limits	30
Setting analog output	32
Setting of bargraph	34
Selection of programming menu „LIGHT“/„PROFI“	36
Restoration of manufacture setting	36
Calibration - input range (DU)	37
Selection of instrument menu language version	38
Setting new access password	38
Instrument identification	39
6. Setting "PROFI" menu	40
6.0 Description of "PROFI" menu	40
6.1 "PROFI" menu - INPUT	
6.1.1 Resetting internal values	42
6.1.2 Setting measuring type, range, mode, rate,	43
6.1.3 Setting the Real Time	49
6.1.4 External input function selection	49
6.1.5 Optional accessory functions of the keys	50
6.2 "PROFI" menu - CHANNEL	
6.2.1 Setting measuring parameters (projection, filters, decimal point, description)	54
6.2.2 Setting mathematic functions	58
6.2.3 Selection of evaluation of min/max. value	60
6.3 "PROFI" menu - OUTPUT	
6.3.1 Setting data logging	62
6.3.2 Setting Limits	64
6.3.3 Setting data output	66
6.3.4 Setting analog output	67
6.3.5 Selection of display projection	69
6.3.6 Selection of bargraph projection	70
6.4 "PROFI" menu - SERVICE	
6.4.1 Selection of programming menu „LIGHT“/„PROFI“	74
6.4.2 Restoration manufacture setting	75
6.4.3 Calibration - input range (DU)	76
6.4.4 Selection of instrument menu language version	76
6.4.5 Setting new access password	76
6.4.6 Instrument identification	77
7. Setting items into "USER" menu	78
7.0 Configuration "USER" menu	78
8. Method of measuring of the cold junction	80
9. Data protocol	81
10. Error statements	82
12. Table of symbols	83
12. Technical data	84
13. Instrument dimensions and installation	86
14. Certificate of guarantee	87
Declaration of conformity	88

## 2 INSTRUMENT DESCRIPTION

### 2.1 Description

The AM3030 model series are 30 LED, 3-colour panel programmable horizontal bar graph designed for maximum efficiency and user comfort while maintaining their favorable price.

The instrument is based on an 8-bit microcontroller with a multi-channel 24-bit sigma-delta converter, which secures high accuracy, stability and easy operation of the instrument.

#### PROGRAMMABLE PROJECTION

Selection: of type of input and measuring range  
Measuring range: adjustable as fixed or with automatic change  
Setting: manual, optional projection on the display may be set in the menu for both limit values of the input signal, e.g. input 0...20 mA > 0...850,0  
Projection: 30-segment LED 3-color bar graph + 6-digit display -9999...9999 (-99999...999999)

#### COMPENSATION

of conduct: in the menu it is possible to perform compensation for 2-wire connection  
of conduct in probe: internal connection (conduct resistance in measuring head)  
of CJC (T/C): manual or automatic, in the menu it is possible to perform selection of the type of thermocouple and compensation of cold junctions, which is adjustable or automatic (temperature at the brackets)

#### DIGITAL FILTERS

Exponen.average: from 2...100 measurements  
Rounding: setting the projection step for display

#### MATHEMATIC FUCTIONS

Min/max. value: registration of min./max. value reached during measurement  
Tare: designed to reset display upon non-zero input signal  
Peak value: the display shows only max. or min. value  
Mat. operations: polynome, 1/x, logarithm, exponential, power, root, sin x

#### EXTERNAL CONTROL

Lock : control keys blocking  
Hold : display/instrument blocking  
Tare : tare activation/resetting tare to zero  
Resetting MM : resetting min/max value  
Memory: data storage into instrument memory

## 2.2 Operation

The instrument is set and controlled by five control keys located on the front panel. All programmable settings of the instrument are performed in three adjusting modes:

- LIGHT** Simple programming menu
- contains solely items necessary for instrument setting and is protected by optional number code
- PROFI** Complete programming menu
- contains complete instrument menu and is protected by optional number code
- USER** User programming menu
- may contain arbitrary items selected from the programming menu (LIGHT/PROFI), which determine the right (see or change)
  - access without password

All programmable parameters are stored in the EEPROM memory (they hold even after the instrument is switched off).

## 2.3 Options

**Excitation** is suitable for supplying power to sensors and transmitters. It has a galvanic separation.

**Comparators** are assigned to monitor one, two, three or four limit values with relay output. The user may select limits regime: LIMIT/DOSING/FROM-TO. The limits have adjustable hysteresis within the full range of the display as well as selectable delay of the switch-on in the range of 0...99,9 s. Reaching the preset limits is signaled by LED and simultaneously by the switch-on of the relevant relay.

**Data outputs** are for their rate and accuracy suitable for transmission of the measured data for further projection or directly into the control systems. We offer an isolated RS232 and RS485 with the ASCII or DIN MessBus protocol.

**Analog outputs** will find their place in applications where further evaluating or processing of measured data is required in external devices. We offer universal analog output with the option of selection of the type of output - voltage/current. The value of analog output corresponds with the displayed data and its type and range are selectable in Menu.

**Measured data record** is an internal time control of data collection. It is suitable where it is necessary to register measured values. Two modes may be used. FAST is designed for fast storage (40 records/s) of all measured values up to 8 000 records. Second mode is RTC, where data record is governed by Real Time with data storage in a selected time segment and cycle. Up to 250 000 values may be stored in the instrument memory.

The instrument supply leads should not be in proximity of the incoming low-potential signals.

Contactors, motors with larger input power should not be in proximity of the instrument.

The leads into the instrument input (measured quantity) should be in sufficient distance from all power leads and appliances. Provided this cannot be secured it is necessary to use shielded leads with connection to ground (bracket E).

The instruments are tested in compliance with standards for use in industrial area, yet we recommend abiding by the above mentioned principles.

### MEASURING RANGES

Type	Input I	Input U
DC	0...60/150/300/1 200 mV	
PM	0...5/20 mA/4...20 mA	±2/±5/±10/±40 V
OHM	0...0,1/1/10/100 kΩ	
RTD-Pt	Pt 100/Pt 500/ Pt 1 000	
RTD-Ni	Ni 1 000/10 000	
T/C	J/K/T/E/B/S/R/N	
DU	Linear potentiometer (min. 500 Ω)	

### OPTION "A"


Type	Input I	Input U
DC	0...1/5 A	±30/120/500 V

### OPTION "B"

Type	Input 2, 3, 4/I	Input 2, 3, 4/U
PM	0...5/20 mA/4...20 mA	±2/±5/±10/±40 V


# INSTRUMENT CONNECTION

Option B





- INPUT - 2/U
- INPUT - 2/I
- INPUT - 3/U
- INPUT - 3/I
- INPUT - 4/U
- INPUT - 4/I
- GND


Option A

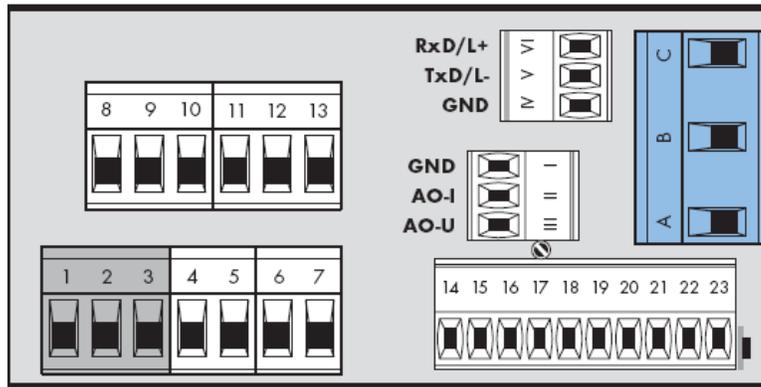

- INPUT - U
- GND
- INPUT - I

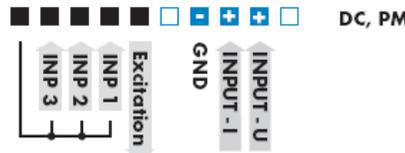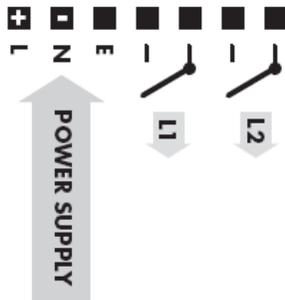

RTD, OHM, Ni




T/C



DU



**!**  
Excitation has the minus pole common with the input - the bracket no. 20 - GND and you may set its value by trimmer above the bracket no. 17

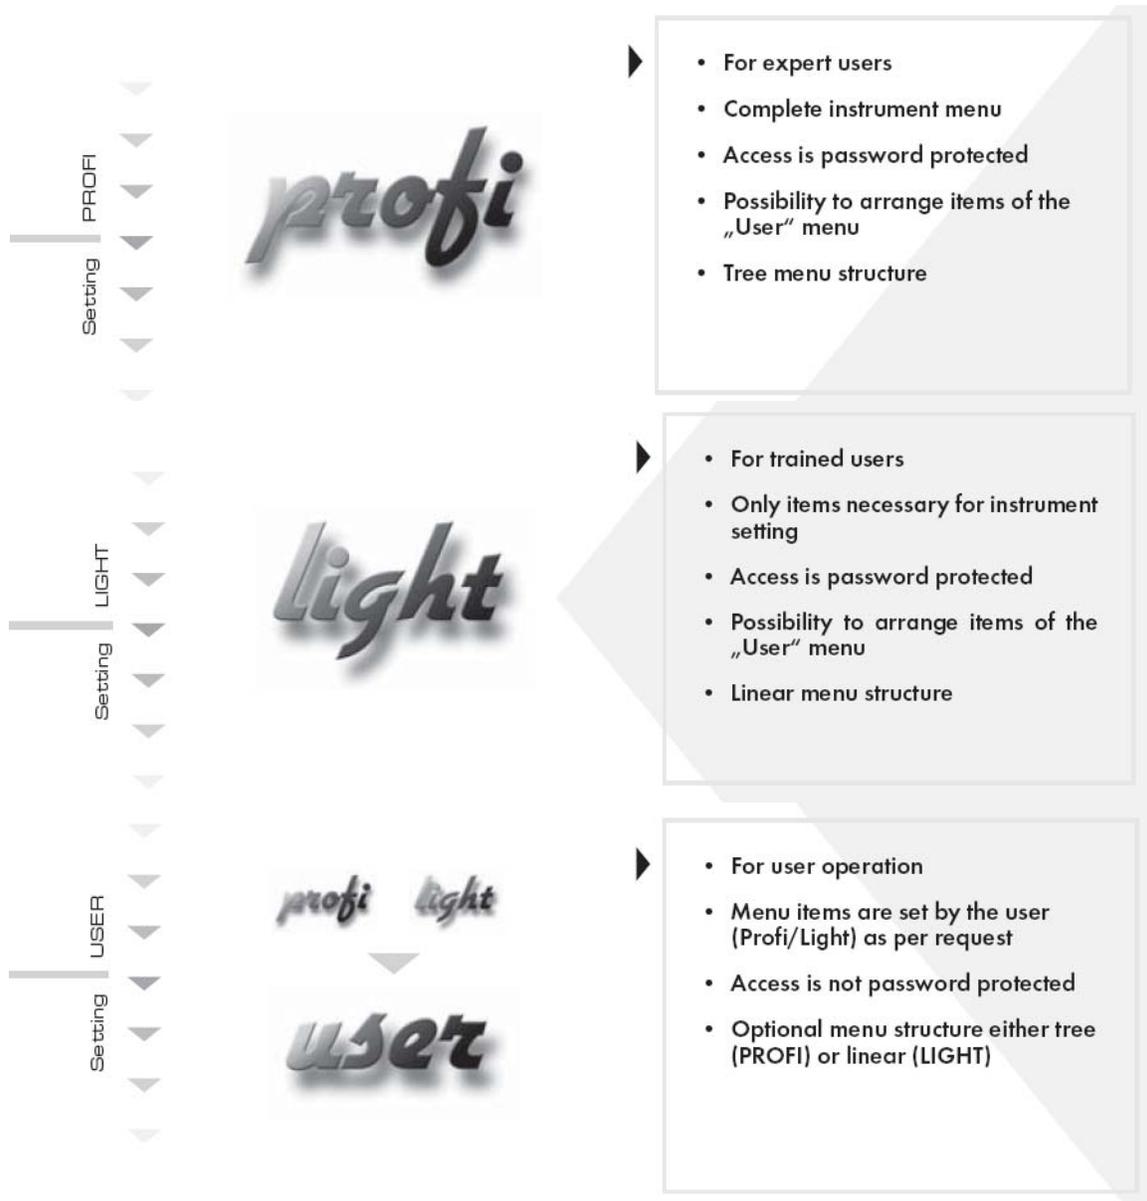


#### 4.1 Setting

The instrument is set and controlled by five control keys located on the front panel. All programmable settings of the instrument are performed in three adjusting modes:

- LIGHT** Simple programming menu
- contains solely items necessary for instrument setting and is protected by optional number code
- PROFI** Complete programming menu
- contains complete instrument menu and is protected by optional number code
- USER** User programming menu
- may contain arbitrary items selected from the programming menu (LIGHT/PROFI), which determine the right (see or change)
  - access without password


All programmable parameters are stored in the EEPROM memory (they hold even after the instrument is switched off).

#### Scheme of processing the measured signal

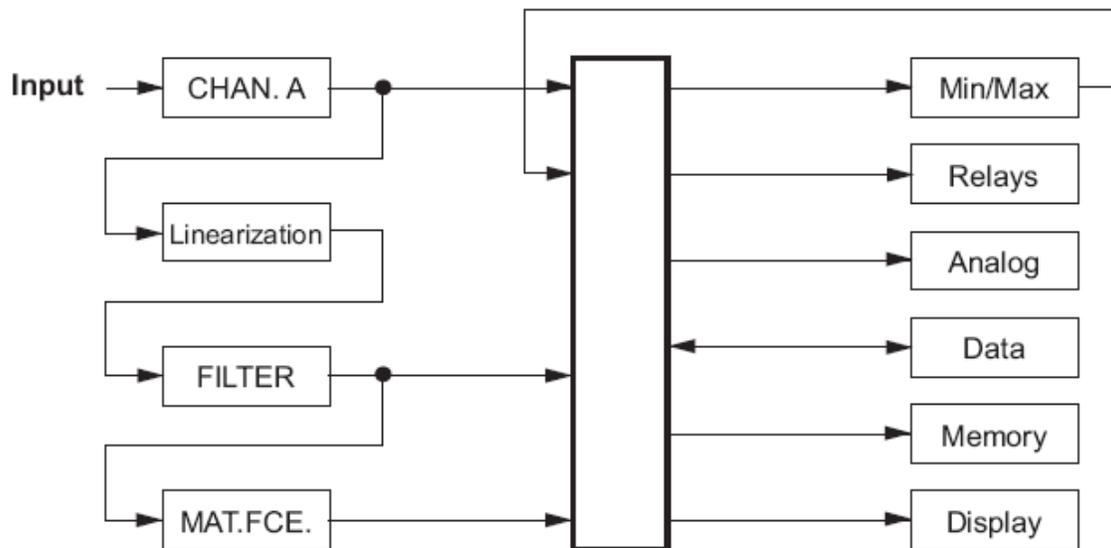

## 4 INSTRUMENT SETTING

Setting and controlling the instrument is performed by means of 5 control keys located on the front panel. With the aid of these keys it is possible to browse through the operation menu and to select and set required values.

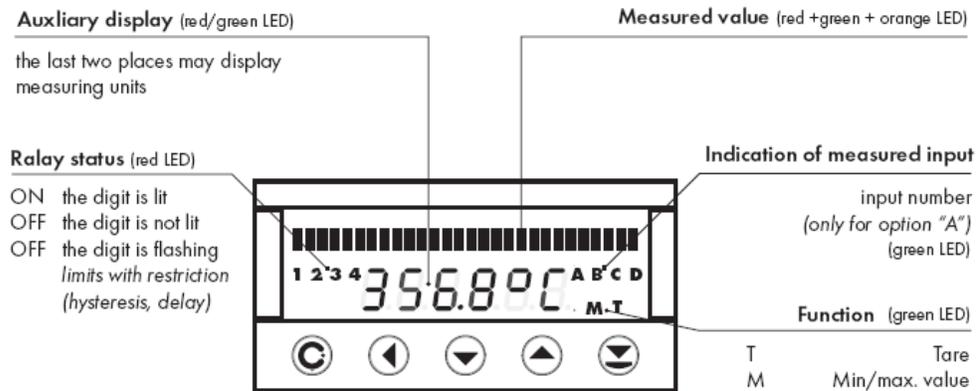

### Symbols used in the instructions

**DC** **PM**  
**DU** **OHM** **RTD** **T/C** Indicates the setting for given type of instrument

**DEF** values preset from manufacture

symbol indicates a flashing light (symbol)

inverted triangle indicates the item that can be placed in USER menu

broken line indicates a dynamic item, i.e. it is displayed only in particular selection/version

after pressing the key the set value will not be stored

after pressing the key the set value will be stored

30 continues on page 30

### Setting the decimal point and the minus sign

#### DECIMAL POINT

Its selection in the menu, upon modification of the number to be adjusted it is performed by the control key with transition beyond the highest decade, when the decimal point starts flashing. Positioning is performed by .

#### THE MINUS SIGN

Setting the minus sign is performed by the key on higher decade. When editing the item subtraction must be made from the current number (e.g.: 013 > , on class 100 > -87)

## Control keys functions

Key	Measurement	Menu	Setting numbers/selection
	access into USER menu	exit menu	quit editing
	programmable key function	back to previous level	move to higher decade
	programmable key function	move to previous item	move down
	programmable key function	move to next item	move up
	programmable key function	confirm selection	confirm setting/selection
			numeric value is set to zero
	access into LIGHT/PROFI menu		
	direct access into PROFI menu		
		configuration of an item for "USER" menu	
		determine the sequence of items in "USER - LIGHT" menu	

## Setting items into „USER“ menu

- in LIGHT or PROFI menu
- no items permitted in USER menu from manufacture
- on items marked by inverted triangle

**user**



- n0** item will not be displayed in USER menu
- YES** item will be displayed in USER menu with the option of setting
- SHOW** item will be solely displayed in USER menu


LIGHT Simple programming menu  
- contains only items necessary for instrument setting and is protected by optional number code



- For capable users
- Only items necessary for instrument setting
- Access is password protected
- Possibility to arrange items of the „User“ menu
- Linear menu structure

**Preset from manufacture**

Password	“0”
Menu	LIGHT
USER menu	off
Setting the items	<b>DEF</b>

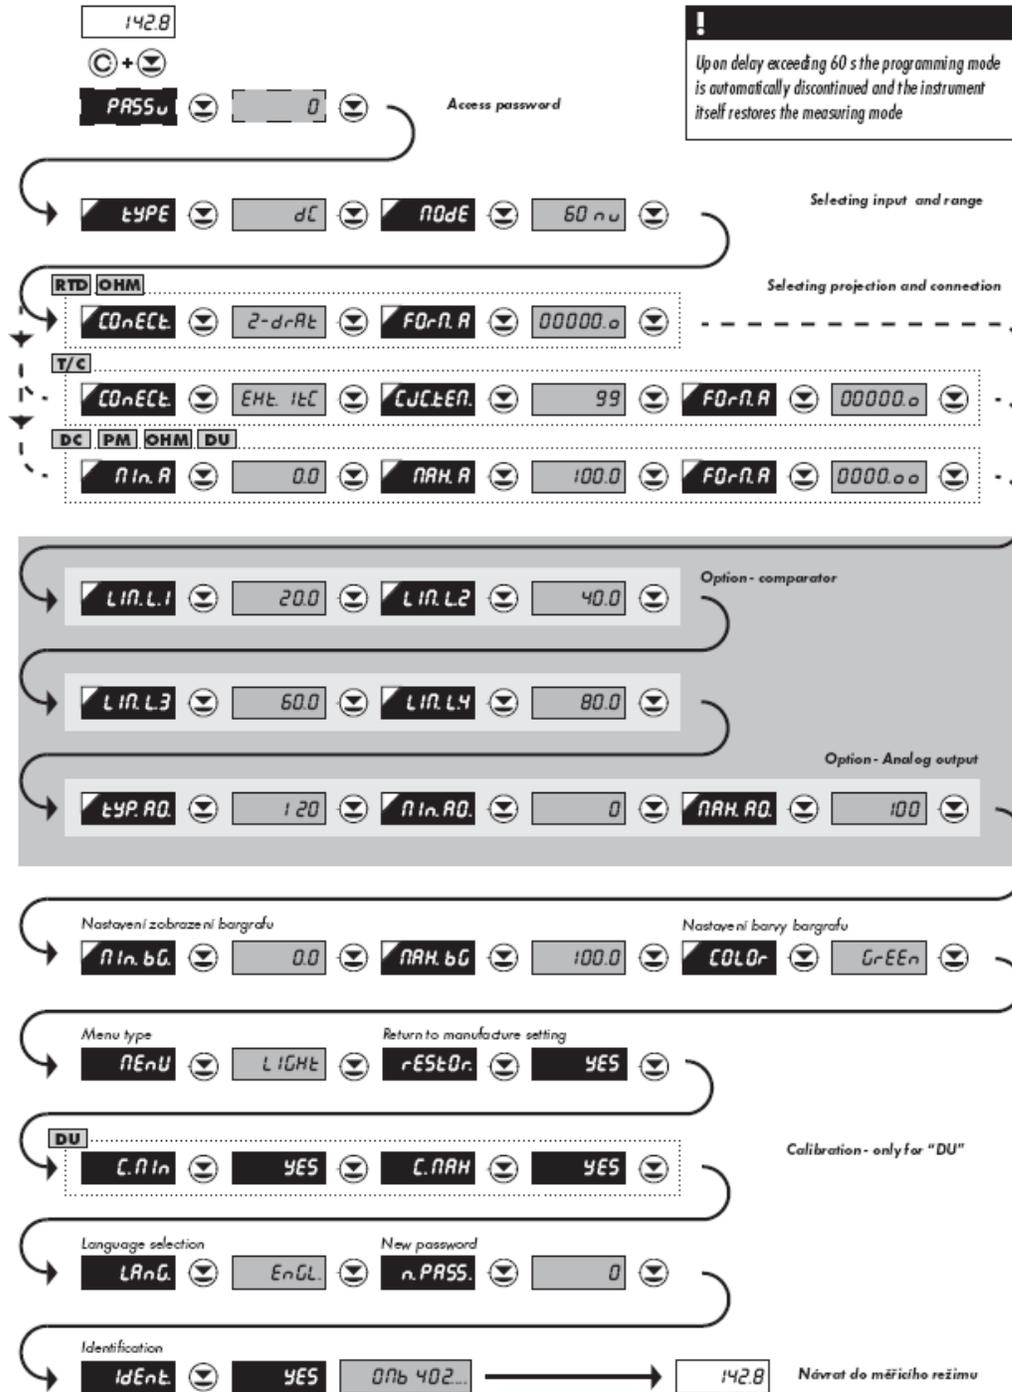

142.8



PASS u.



0

Entering access password  
for access into the menu



**PASS u.** Access into instrument menu DC PM DU OHM RTD T/C

**PAS = 0**

- access into menu is unrestricted, after releasing keys you automatically move to first item of the menu

**PAS > 0**

- access into menu is protected by number code

Set "Password" = 42 Example

0 1 2 3 4 5 6 7 8 9

32 42

TYPE

TYPE



DC PM OHM rtd-Pt rtd-ni TC

DU

TYPE

**TYPE** Selection of the type of instrument

- primary selection of the type of instrument
- performs default setting **DEF** of values from manufacture, incl. calibration

Menu	Type of Instrument
DC	DC voltmeter
PM	Process monitor
OHM	Ohmmeter
RTD-Pt	Thermometer for sensors Pt
RTD-Ni	Thermometer for sensors Ni
TC	Thermometer for thermocouples
DU	Display for lin. potentiometer

Type "PM" Example

DC PM

DEF

Type "DC"	16
Type "PM"	18
Type "DU"	20
Type "OHM"	22
Type "RTD-Pt"	24
Type "RTD-Ni"	26
Type "T/C"	28

Type "DC"

**n0dE** → [ 60 nV | 150 nV | 300 nV | 1200 nV ] [ DC ]

**n0dE** Selection of the Instrument measuring range

**DEF** - 60 mV

MODE	Menu	Measuring range
	60 mV	±60 mV
	150 mV	±150 mV
	300 mV	±300 mV
	1200mV	±1,2 V

Range ±150 mV Example

[ 60 nV ] [ 150 nV ] [ n In R ]

**n In R.** → [ 0 ] Setting for minimum input signal

**n In R.** Setting display projection for minimum value of input signal


- position of the DP does not affect display projection
- the DP is automatically shifted after the value is confirmed

- range of the setting is -99999...999999

**DEF** - 0

Projection for 0 mV > Min = 0 Example

[ 0 ] [ n In R ]

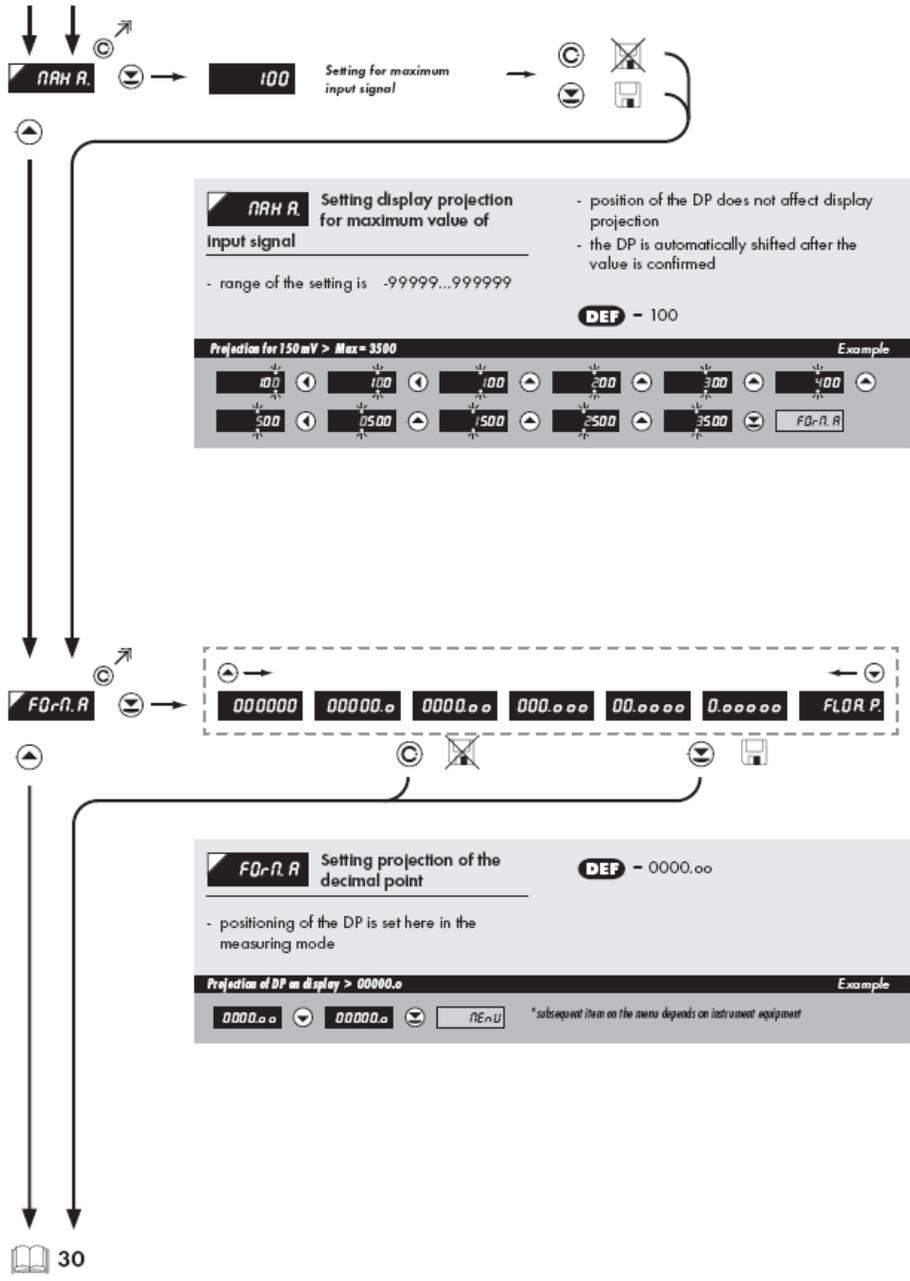

**MAX R.** Setting for maximum input signal

100

Setting for maximum input signal

**MAX R.** Setting display projection for maximum value of input signal

- position of the DP does not affect display projection
- the DP is automatically shifted after the value is confirmed

range of the setting is -99999...999999

**DEP** - 100

Projection for 150 mV > Max= 3500 Example

100	100	100	200	300	400
500	500	500	500	500	500

FD-R.A

**FD-R.A.** Setting projection of the decimal point

000000 00000.0 0000.00 000.000 00.0000 0.00000 FLOR P.

0000.00

**FD-R.A.** Setting projection of the decimal point

- positioning of the DP is set here in the measuring mode

**DEP** - 0000.00

Projection of DP on display > 00000.0 Example

0000.00	00000.0	MENU
---------	---------	------

\* subsequent item on the menu depends on instrument equipment







Type "DU"

**Min R.** Setting for minimum input signal → 0

Setting for minimum input signal → [OK] [Cancel] [Save]

**Min R.** Setting display projection for minimum value of input signal

- position of the DP does not affect display projection
- the DP is automatically shifted after the value is confirmed

- range of the setting is -99999...999999

**DEF** - 0

**Projection for the beginning > Min = 0** Example

0 [OK] [Cancel] [Save]

**Max R.** Setting for maximum input signal → 100

Setting for maximum input signal → [OK] [Cancel] [Save]

**Max R.** Setting display projection for maximum value of input signal

- position of the DP does not affect display projection
- the DP is automatically shifted after the value is confirmed


- range of the setting is -99999...999999

**DEF** - 100

**Projection for the end > Max = 5000** Example

00 [OK] 100 [OK] 100 [OK] 000 [OK] 0000 [OK] 1000 [OK]

2000 [OK] 3000 [OK] 4000 [OK] 5000 [OK] [OK] [Cancel] [Save]

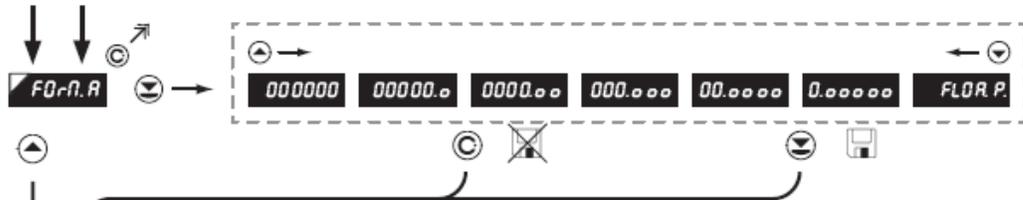

**FD-R.A** Setting projection of the decimal point **DEF** - 0000.00

- positioning of the DP is set here in the measuring mode

---

**Projection of DP on display > 0000.00** Example

**0000.00**  \* subsequent item on the menu depends on instrument equipment


 **30**

Calibration of the beginning and the end of range of linear potentiometer is on page 35







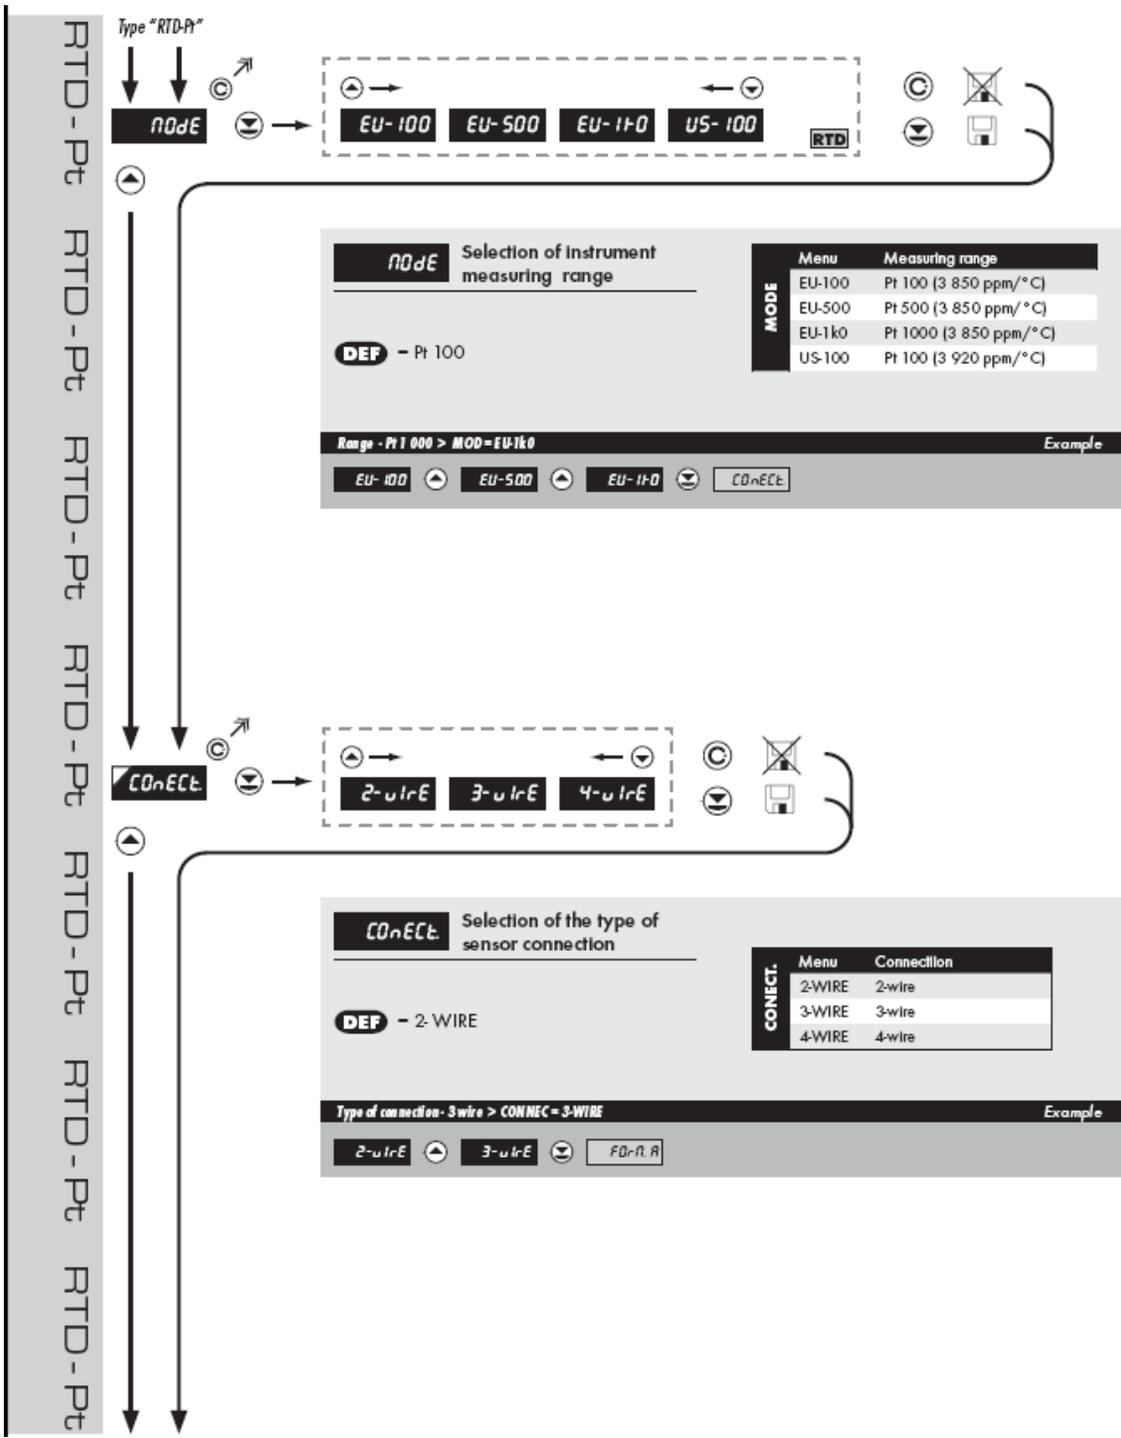





**F0r.N.R** Setting projection of the decimal point **DEF** - 00000.0

- positioning of the DP is set here in the measuring mode

**Projection of DP on display > 000000** **Example**


00000.0 ▾ 000000 ▾ **REnD** \* subsequent item on the menu depends on instrument equipment

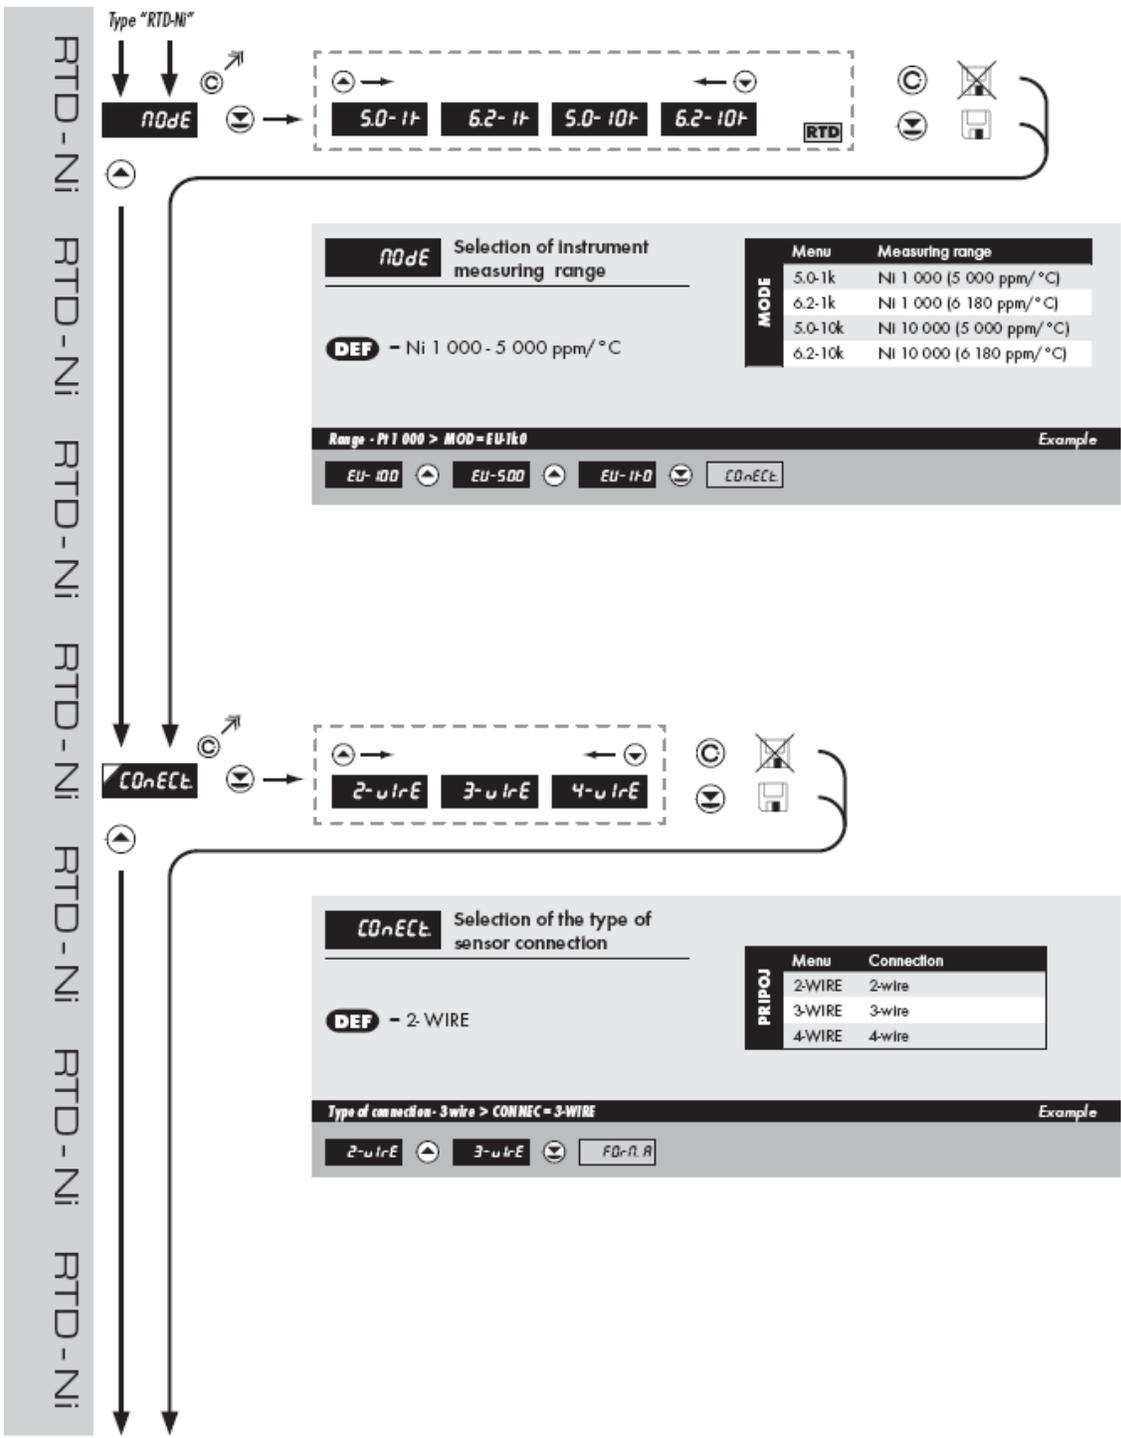

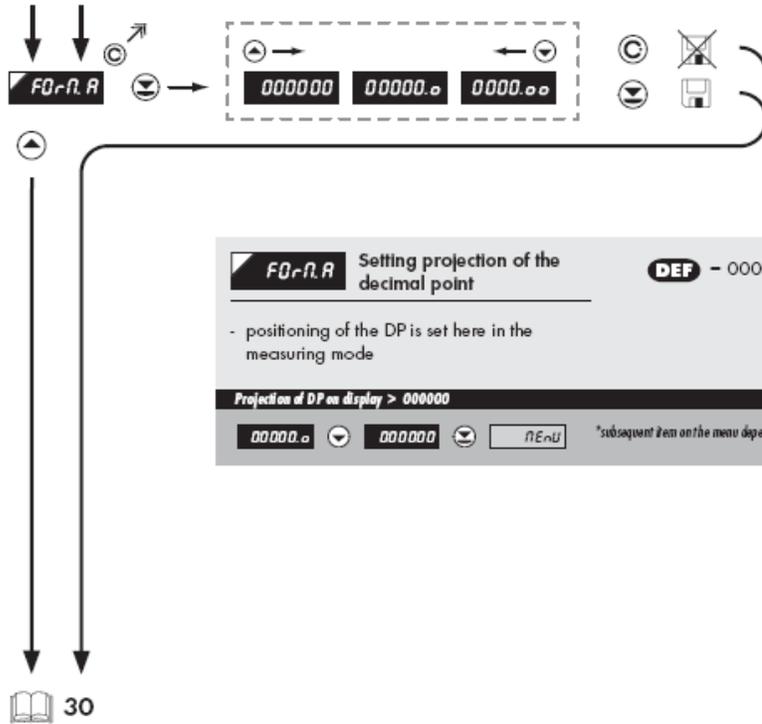

T/C T/C

Type "T/C"

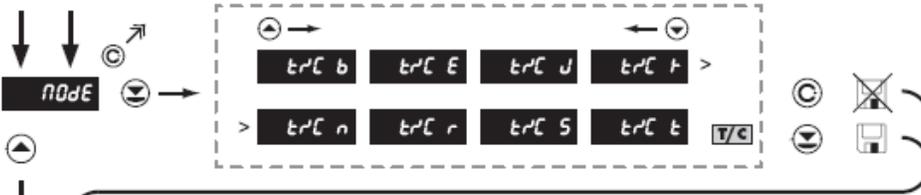

**nDdE** Selection of the type of thermocouple

- setting the input range depends on the measuring range ordered

**DEF** - Type "J"

MODE	Menu	Type of thermocouple
	T/C B	B
	T/C E	E
	T/C J	J
	T/C K	K
	T/C N	N
	T/C R	R
	T/C S	S
	T/C T	T

Type of thermocouple "X" Example

J T F0-R.A



**F0-R.A** Setting projection of the decimal point **DEF** - 00000.0

- positioning of the DP is set here in the measuring mode

Projection of DP on display > 000000 Example

00000.0 000000 nEnU \* subsequent item on the menu depends on instrument equipment

**!**  
Measuring temperature of CJC is on instrument brackets. Method In. 1 (see page 56)

**LIM L.1** → **20** Setting boundary for limit 1

**LIM L.1** Setting boundary for limit 1

- range of the setting is -99999...999999
- default "Hysteresis"=0 "Delay"=0

**DEF** - 20

**Setting limit 1 > L1 = 32** **Example**

**LIM L.2** → **40** Setting boundary for limit 2

**LIM L.2** Setting boundary for limit 2

- range of the setting is -99999...999999
- default "Hysteresis"=0 "Delay"=0

**DEF** - 40

**Setting limit 2 > L2 = 53.1** **Example**

\* subsequent item on the menu depends on instrument equipment



Items for "Limits" and "Analog output" are accessible only if incorporated in the instrument.



**LIN L3** Setting boundary for limit 3


- contingent modification of hysteresis or delay may be performed in "PROFI" menu

- range of the setting is -99999...999999  
- default "Hysteresis"=0 "Delay"=0

**DEF** - 60

Setting limit 3 > L3 = 85 Example

60	61	62	63	64	65
65	75	85	Menu		

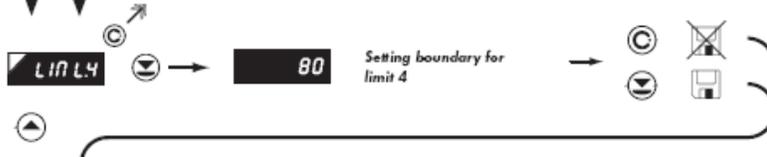

**LIN L4** Setting boundary for limit 4

- contingent modification of hysteresis or delay may be performed in "PROFI" menu

- range of the setting is -99999...999999  
- default "Hysteresis"=0 "Delay"=0


**DEF** - 80

Setting limit 4 > L4 = 103 Example

80	81	82	83	83	93
03	003	103	Menu		

\* subsequent item on the menu depends on instrument equipment

Displayed only with options > **Comparators**

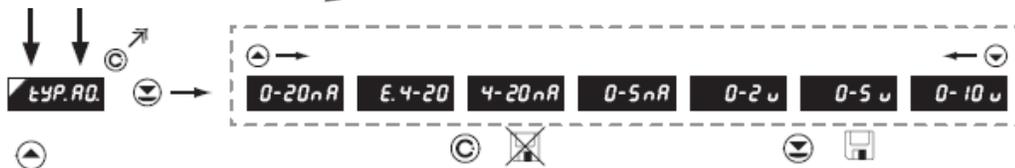


**TYP. AO.** Setting the type of analog output

Menu	Range	Description
0-20mA	0...20 mA	
E. 4-20mA	4...20 mA	with indication of error statement (<3,6 mA)
4-20mA	4...20 mA	
0-5mA	0...5 mA	
0-2 V	0...2 V	
0-5 V	0...5 V	
0-10 V	0...10 V	

**DEF** - 4...20 mA

Type of analog output - 0...10V > Type = 0 10 Example

4-20nA 0-5nA 0-2 u 0-5 u 0-10 u TYP. AO.

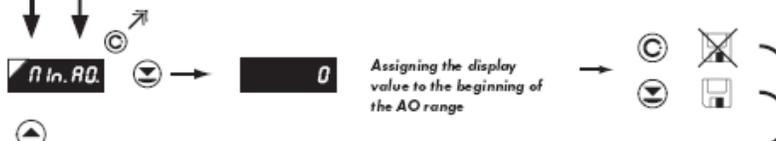


**MIN. AO.** Assigning the display value to the beginning of the AO range **DEF** - 0

- range of the setting is -99999...999999

Display value for the beginning of the AO range > A.MIN = 0 Example

0 MIN. AO.

! Items for "Limits" and "Analog output" are accessible only if incorporated in the instrument.

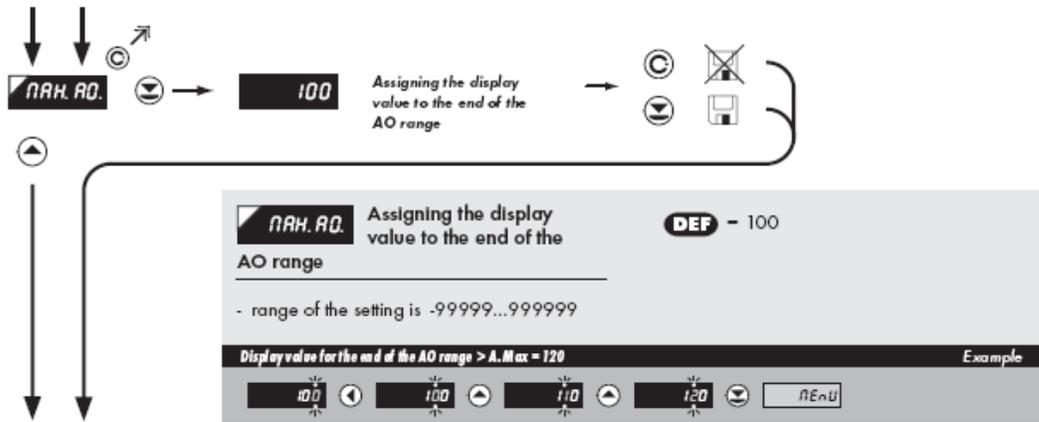

Displayed only with options > **Analog output**



**Min b.G.** Setting bargraph projection for minimum input signal value

- range of the setting is -99999...999999 **DEF - 0**

**Projection for the beginning > Min = 0** Example



**Max b.G.** Setting bargraph projection for maximum input signal value

- range of the setting is -99999...999999 **DEF - 100**

**Projection for the end > Max = 5000** Example



**COLOr** Select bargraph color

- for other bargraph working modes it is necessary to switch to the "PROFI" menu


- the color for bargraph in basic mode "Column" is set here

**DEF** - Green

---

*Selection of bargraph color > Orange* *Example*

GrEEen    OrAnGE    nEnU

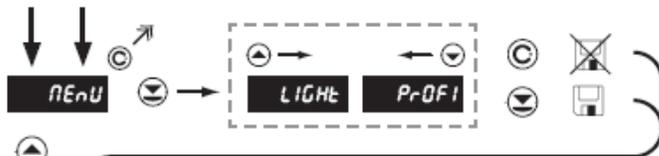**nEnU**Setting the menu type  
LIGHT/PROFI

**LIGHT** > menu LIGHT, a simple menu,  
which contains only the most essential items  
necessary for instrument setting  
> linear tree structure

**PROFI** > menu PROFI, a complete menu for  
complete instrument setting  
> tree menu structure

**DEF** - LIGHT

Menu LIGHT &gt; MENU = LIGHT

Example

**LIGHT** **rEStOr.****rEStOr.**Restoration of manufacture  
instrument setting

- in the event of error setting or calibration it is  
feasible to restore manufacture setting. Prior

to execution of any modifications you will be  
asked to confirm your selection. (YES)  
- loading manufacture calibration and  
primary setting of items on the menu (DEF)

Restoration of manufacture setting &gt; RESTOR.


Example

**rEStOr.** **YES** **LArd.**

\* subsequent item on the menu depends on instrument type, for "DU" &gt; "K MIN"

Type „DC“		36
Type "PM"		36
Type "DU"		35
Type "OHM"		36
Type "RTD-Pt"		36
Type "RTD-Ni"		36
Type "T/C"		36



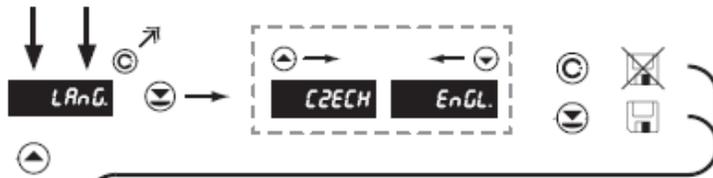

**LANG.** Selection of language in instrument menu

- selection of language version of the instrument menu

**DEF** - ENGL.

Language selection - ENGLISH > LANG. = ENGL. Example

CZECH  ENGL.  n.PASS



**n.PASS.** Setting new access password

- access password for menu LIGHT/PROFI

- range of the number code 0...9999


- upon setting the password to "000" the access to menu LIGHT/PROFI is free without prompt to enter it

- in the event of loss universal password "8177" may be used

**DEF** - 0

New password - 341 > n.PASSW. = 341 Example

0	1	01	11	21	31
41	041	141	241	341	idEnt.

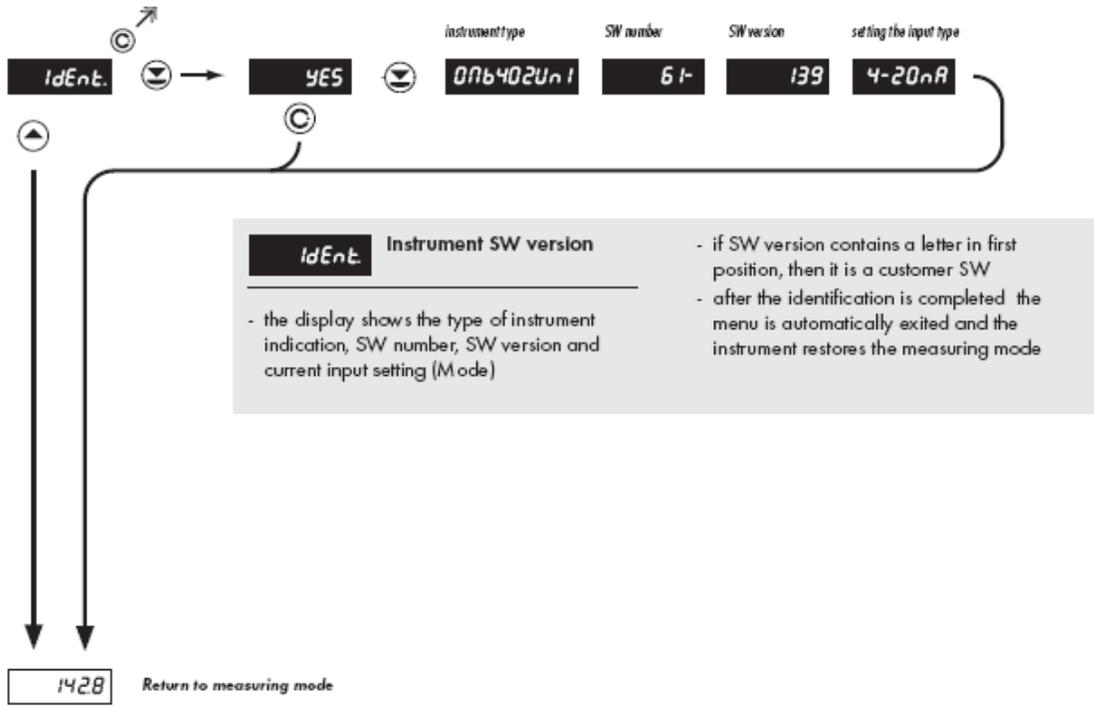

**PROFI****Complete programming menu**

- contains complete instrument menu and is protected by optional number code
- designed for expert users
- preset from manufacture is menu **LIGHT**


**Switching over to "PROFI" menu**

- temporary switch-over to **PROFI** menu, which is suitable to edit a few items
- after quitting **PROFI** menu the instrument automatically switches to **LIGHT** menu
- access is password protected (if it was not set under item N. PASS. =0)



- access into **LIGHT** menu and transition to item „MENU“ with subsequent selection of „PROFI“ and confirmation
- after re-entering the menu the **PROFI** type is active
- access is password protected (if it was not set under item N. PASS. =0)


#### 6.1 Setting "PROFI" - INPUT

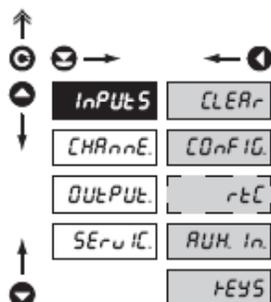

The primary instrument parameters are set in this menu

- CLEAR** Resetting internal values
- COnFIG** Selection of measuring range and parameters
- rTc** Setting date and time for option with RTC
- AUH. In.** Setting external inputs functions
- KEYS** Assigning further functions to keys on the instrument

#### 6.1.1 Resetting internal values

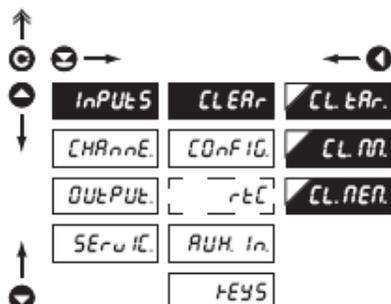

- CLEAR** Resetting internal values
- CL.tAr.** Tare resetting
- CL.n.** Resetting min/max value
  - resetting memory for the storage of minimum and maximum value achieved during measurement
- CL.nEr.** Resetting the instrument memory
  - resetting memory with data measured in the "FAST" or "RTC" modes
  - not in standard equipment

## 6.1.2a Selection of measuring rate

↑	⊖ →				← ⊕	
⊕		<b>inPUtS</b>	CLERr	rERdRS		40.0
⊖		CHAnnE	<b>COnf IG.</b>	tYPE		20.0
		OUtPUt	rEtC	NOdE		10.0
		SErviC	AUH. In.	COncEt		5.0
			FEYS	CJ.tEN.		2.0
				Ad.rES.		1.0
				LEAdS		0.5
						0.2
						0.1

**DEF**

**rERdRS** Selection of measuring rate

40.0	40,0 measurements/s
20.0	20,0 measurements/s
10.0	10,0 measurements/s
5.0	5,0 measurements/s
2.0	2,0 measurements/s
1.0	1,0 measurement/s
0.5	0,5 measurements/s
0.2	0,2 measurements/s
0.1	0,1 measurements/s

## 6.1.2b Selection of „Instrument“ type


↑	⊖ →				← ⊕	
⊕		<b>inPUtS</b>	CLERr	rERdRS		dC
⊖		CHAnnE	<b>COnf IG.</b>	<b>tYPE</b>		Pn
		OUtPUt	rEtC	NOdE		OHn
		SErviC	AUH. In.	COncEt		rtd-Pt
			FEYS	CJ.tEN.		rtd-ni
				Ad.rES.		tC
				LEAdS		dU


**DEF**

**tYPE** Selection of „Instrument“ type

- selection of particular type of „instrument“ is bound to relevant dynamic items

dC	DC voltmeter
Pn	Process monitor
OHn	Ohmmeter
rtd-Pt	Thermometer for Pt xxx
rtd-ni	Thermometer for Ni xxxx
tC	Thermometer pro thermocouples
dU	Display for linear potentiometers


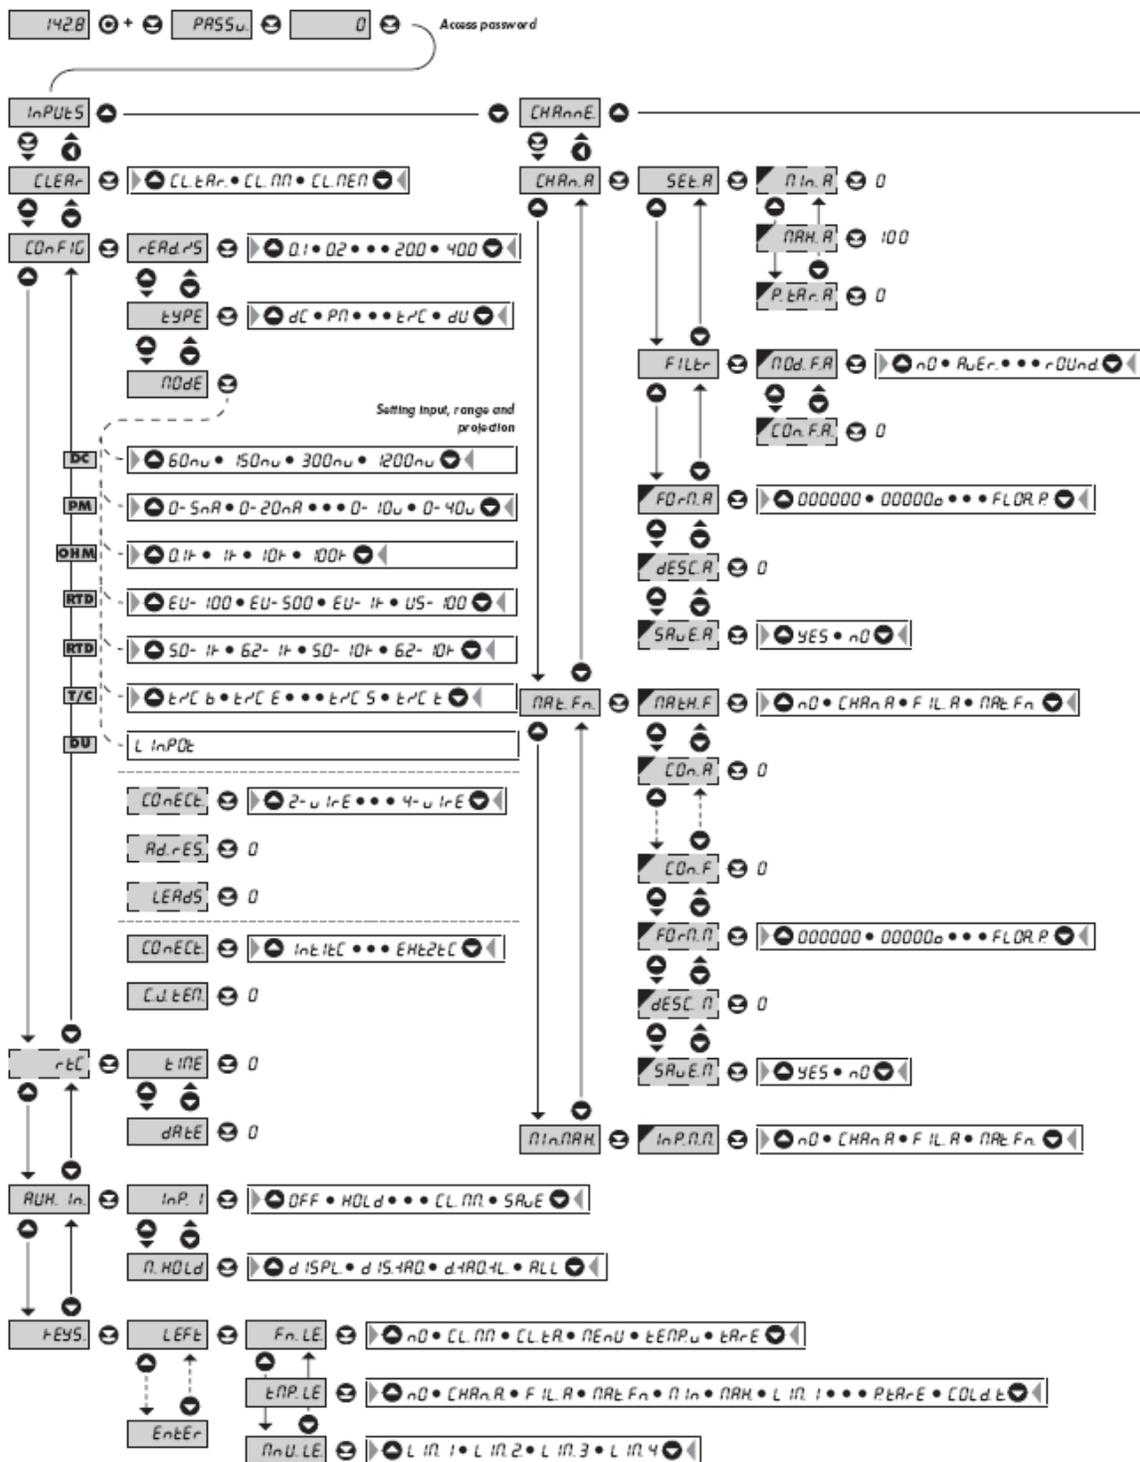


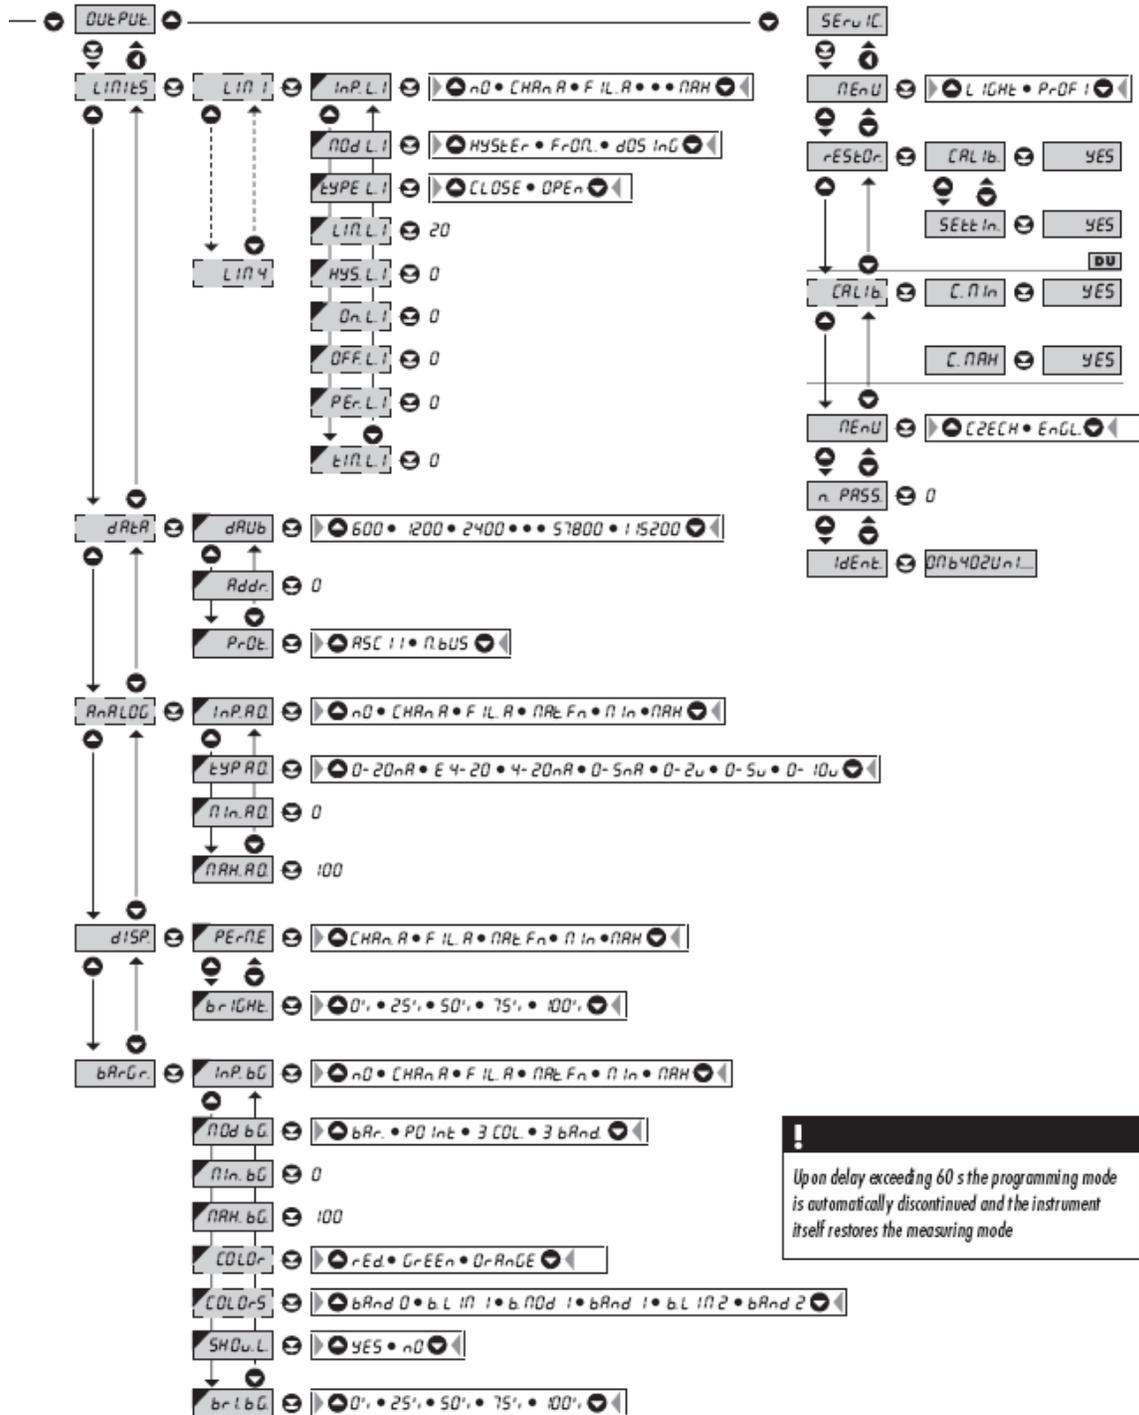



## 6.1.2d Selection of type of sensor connection

RTD OHM T/C

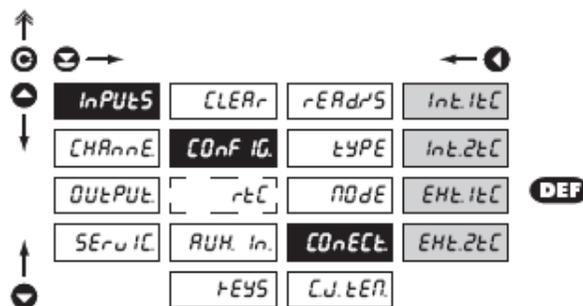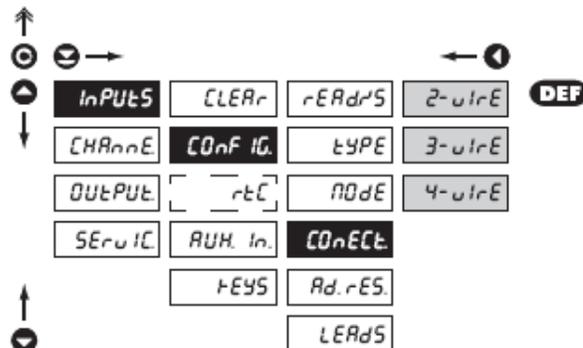**CONNECT** Selection of type of sensor connection**RTD OHM**

- 2-wire** 2-wire connection
- 3-wire** 3-wire connection
- 4-wire** 4-wire connection

**T/C**


- Int. 1tC** Measurement without reference thermocouple
  - measuring cold junction at instrument brackets
- Int. 2tC** Measurement with reference thermocouple
  - measuring cold junction at instrument brackets with anti-series connected reference thermocouple
- Ext. 1tC** Measurement without reference thermocouple
  - the entire measuring set is working under invaried and constant temperature
- Ext. 2tC** Measurement with reference thermocouple
  - when using compensation box

**!**  
Method and procedure of setting the cold junctions is described in separate chapter on page 80

**!**  
For thermocouple type "B" the items CONNECT and CJ. TEM. are not available

#### 6.1.2e Setting temperature of cold junction

**T/C**

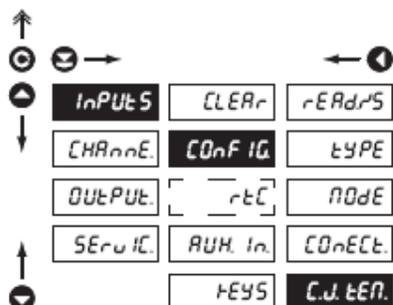


**C.J. tEN.** Setting temperature of cold junction

- range 0...99°C with compensation box
- **DEF** - 23°C

#### 6.1.2f Compensation of 2-wire conduct

**RTD OHM**

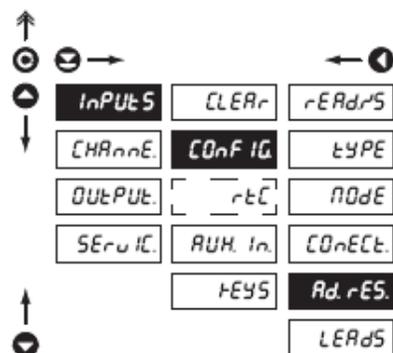


**Ad. rES.** Offset of the beginning of the measuring range

- in cases when it is necessary to offset the beginning of the range by certain value, e.g. while using sensor in measuring head
- entered directly in Ohm (0...9999)
- **DEF** - 0

#### 6.1.2g Compensation of 2-wire conduct


**RTD OHM**

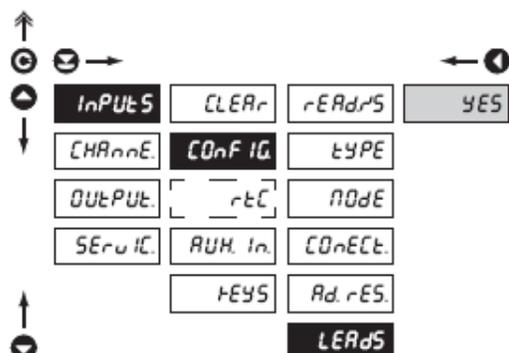

**LEAdS** Compensation of 2-wire conduct

- for measurement accuracy it is necessary to perform compensation of conduct always in case of 2-wire connection
- prior confirmation of the displayed prompt „YES“ it is necessary to substitute the sensor at the end of the conduct by a short-circuit
- **DEF** - 0

## 6.1.3 Setting the real time clock

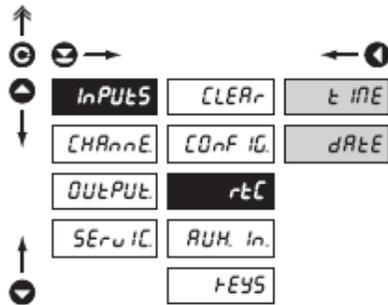**rtC** Setting the real time clock (RTC)


tIME Time setting

- format 23.59.59

dATE Date setting

- format DD.MM.YY

## 6.1.4a External Input function selection

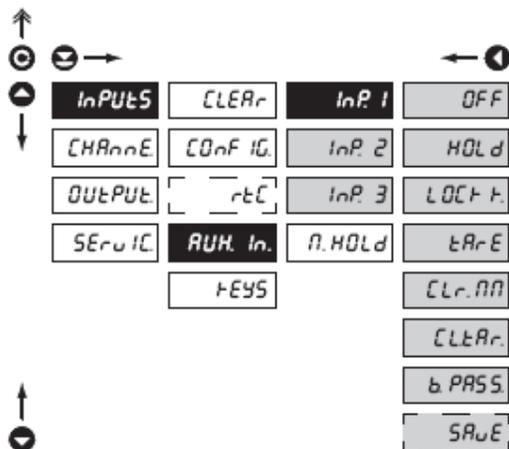**AUH. In.** External Input function selection

OFF Input is off

HOLD Activation of HOLD

LOCK K. Locking keys on the instrument

tARE Tare activation

CLr.nn Resetting min/max value

CLtAr. Tare resetting

b.PASS Activation of locking access into programming menu LIGHT/PROFI


SAR.E Activation of measured data record in instrument memory (not in standard equipment)

- **DEF** INPUT 1 > HOLD- **DEF** INPUT 2 > LOCK K.- **DEF** INPUT 3 > TARE

\*

Setting procedure is identical for Input 2 and Input 3


#### 6.1.4b Selection of function "HOLD"

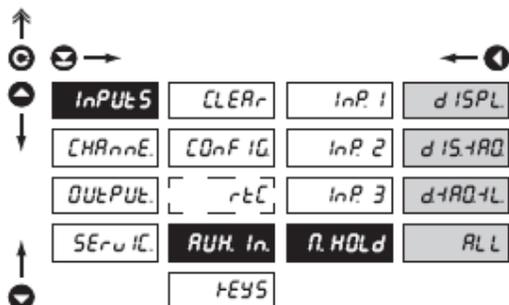

#### n.HOLD Selection of function "HOLD"

- d ISPL.** "HOLD" locks only the value displayed
- d IS. TRQ.** "HOLD" locks the value displayed and on AO
- d. TRQ. TL.** "HOLD" locks the value displayed, on AO and limit evaluation
- ALL** "HOLD" locks the entire instrument

#### 6.1.5a Optional accessory functions of the keys

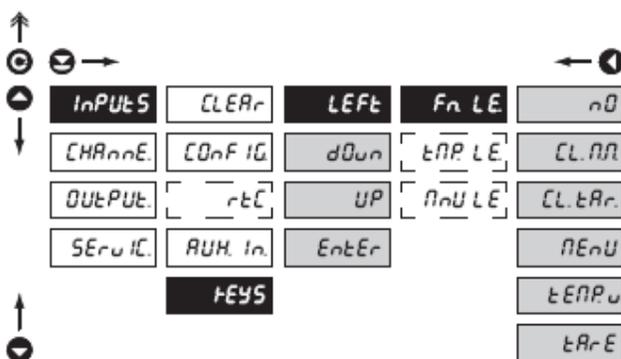


#### Fn. LE. Assigning further functions to instrument keys

- „FUNC.“ > executive functions
  - „TEMPOR.“ > temporary projection of selected values
  - „MENU“ > direct access into menu on selected item
- nD** Key has no further function
  - CL. nN** Resetting min/max value
  - CL. tAr.** Tare resetting
  - nEnU** Direct access into menu on selected item
  - after confirmation of this selection the "MENU" item is displayed on superior menu level, where required selection is performed
  - tENP. u.** Temporary projection of selected values
  - after confirmation of this selection the item "TEMPOR." is displayed on superior menu level, where required selection is performed
  - tArE** Tare function activation



Setting is identical for LEFT, DOWN, UP and ENTER

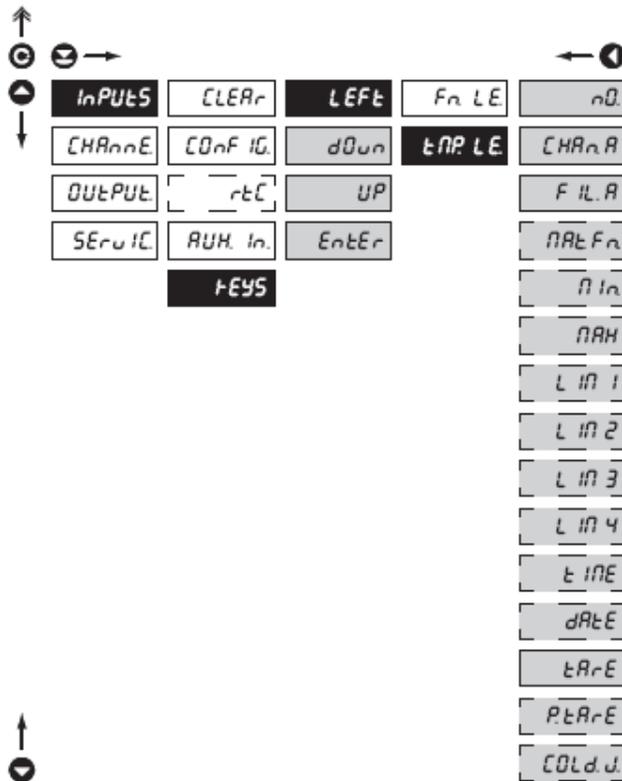

### TEMP. LE Temporary projection of selected item


- "Temporary" projection of selected value is displayed for the time of keystroke
- "Temporary" projection may be switched to permanent by pressing  $\odot$  + "Selected key", this holds until the stroke of any key

nD	Temporary projection is off
CHARA	Temporary projection of "Channel A" value
FIL.A	Temporary projection of "Channel A" value after processing digital filters
MATH.Fn	Temporary projection of "Mathematic functions" value
Min	Temporary projection of "Min. value"
Max	Temporary projection of "Max. value"
LIM 1	Temporary projection of "Limit 1" value
LIM 2	Temporary projection of "Limit 2" value
LIM 3	Temporary projection of "Limit 3" value
LIM 4	Temporary projection of "Limit 4" value
TIME	Temporary projection of "TIME" value
DATE	Temporary projection of "DATE" value
TARE	Temporary projection of "TARE" value
P.TARE	Temporary projection of "P. TARE" value
CJC	Temporary projection of "CJC" value



Setting is identical for LEFT, DOWN, UP and ENTER

#### 6.1.5c Optional accessory functions of the keys - Direct access to item

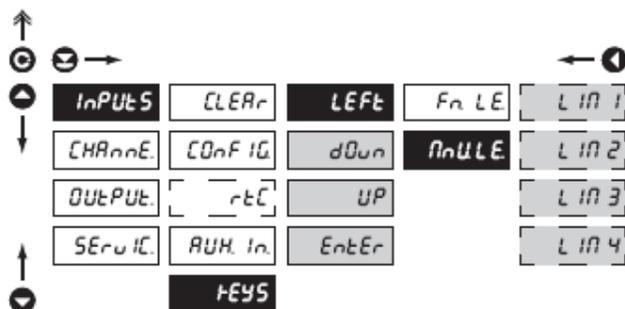


#### nU.LE. Assigning access to selected menu item

- LIN 1 Direct access to item "LIM 1"
- LIN 2 Direct access to item "LIM 2"
- LIN 3 Direct access to item "LIM 3"
- LIN 4 Direct access to item "LIM 4"



Setting is identical for LEFT, DOWN, UP and ENTER

## 6.2 Setting "PROFI" - CHANNELS




The primary instrument parameters are set in this menu

- CHAn.A** Setting parameters of measuring "Channel"
- nAR.Fn** Setting parameters of mathematic functions
- nIn.nAR** Selection of access and evaluation of Min/max value

## 6.2.1a Display projection

**DC PM DU OHM**

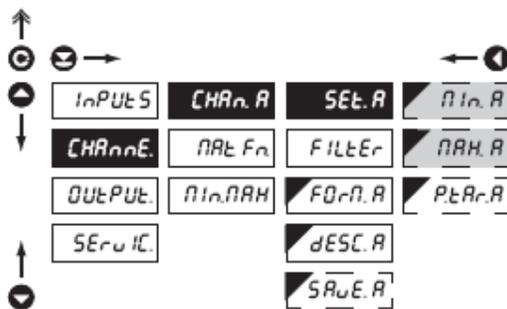

**SEt.A** Setting display projection

**nIn.A** Setting display projection for minimum value of input signal


- range of the setting is -99999...999999
- **DEF** - 0

**nAR.A** Setting display projection for maximum value of input signal

- range of the setting is -99999...999999
- **DEF** - 100

## 6.2.1b Setting fixed tare


**DC PM DU OHM**

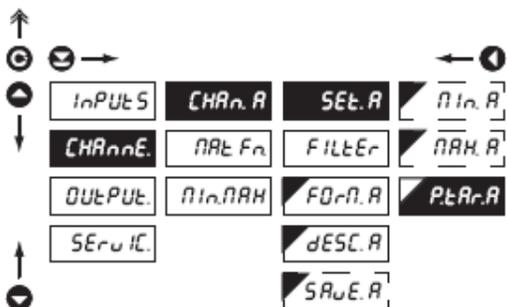

**P.tAR.A** Setting "Fixed tare" value

- setting is designed for the event when it is necessary to firmly shift the beginning of the range by known size
- when setting (P.TAR. A > 0) display shows "T" symbol
- range of the setting is 0...999999
- **DEF** - 0

#### 6.2.1c Digital filters

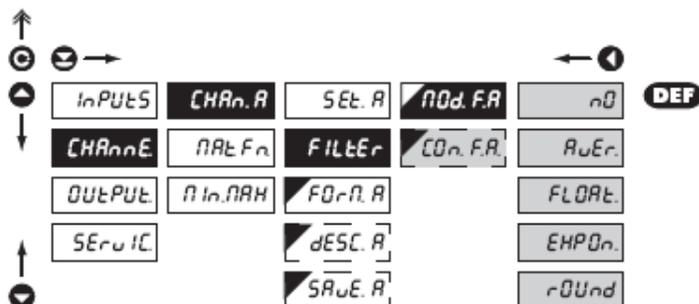

#### NOd.F.A Selection of digital filters

- at times it is useful for better user projection of data on display to modify it mathematically and properly, wherefore the following filters may be used:

**n0** Filters are off

**RuEr** Measured data average

- arithmetic average from given number („CON.F. A.“) of measured values
- range 2...100

**FLDAE** Selection of floating filter

- floating arithmetic average from given number („CON.F. A.“) of measured data and updates with each measured value
- range 2...30

**EHPOn** Selection of exponential filter

- integration filter of first prvniho grade with time constant („CON.F. A.“) measurement
- range 2...100

**rDUnd** Measured value rounding


- is entered by any number, which determines the projection step (e.g: „CON.F. A.“=2,5 > display 0, 2.5, 5,...)

**CO.n.F.A** Setting constants

- this menu item is always displayed after selection of particular type of filter

**DEF** - 2

## 6.2.1d Projection format - positioning of decimal point

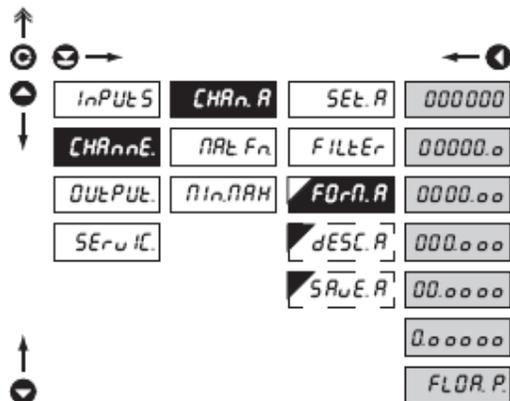**FOrN.R** Selection of decimal point

- the instrument allows for classic projection of a number with positioning of the DP as well as projection with floating DP, allowing to display a number in its most exact form „FLOAT.P.“

000000. Setting DP - XXXXXX.

00000.0 Setting DP - XXXXX.x

- **DEF** > **RTD** **T/C**

0000.00 Setting DP - XXXX.xx

- **DEF** > **DC** **PM** **DU** **OHM**


000.000 Setting DP - XXX.xxx

00.0000 Setting DP - XX.xxxx

0.00000 Setting DP - X.xxxxx

FLoR.P. Floating DP

## 6.2.1e Projection of description - the measuring units

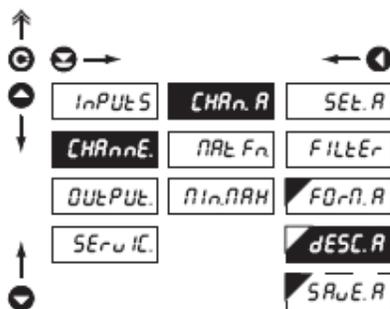**dESC.A** Setting projection of descrpt. for "Channel A"

- projection of measured data may be extended (at the expense of the number of displayed places) by two characters for description
- description is set by shifted ASCII code, when two first places show the set description and two last characters their code in period 0...95
- description is cancelled by code 00

- **RTD** **T/C** **DEF** - °C

- **DC** **PM** **DU** **OHM** **DEF** -none

!

Table of signs on page 83

6.2.1f Selection of storing data into Instrument memory

↑	⊙	→							
⊙			INPUTS	CHAR.A	SET.A			YES	
↓			CHAR.A	PAR.F.A	FILTER			NO	
			OUTPUT	IN.PAR	FOR.A				
↑			SERVIC		DESC.A				
⊙					SAVE.A				


**SAVE.A** Selection of storing data into Instrument memory

- by selection in this item you allow to register values into instrument memory
- another setting in item "OUTPUT > MEMORY" (not in standard experiment)

YES Measured data are stored in the memory

NO Measured data are not stored

## 6.2.2a Mathematic functions

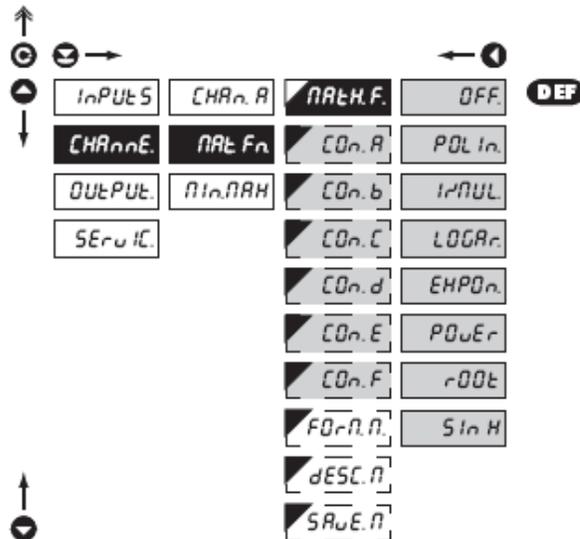**MATH.F.** Selection of mathematic functions

**OFF.** Mathematic functions are off

**POL In** Polynome

$$Ax^5 + Bx^4 + Cx^3 + Dx^2 + Ex + F$$

**1/nUL**  $1/x$

$$\frac{A}{x^5} + \frac{B}{x^4} + \frac{C}{x^3} + \frac{D}{x^2} + \frac{E}{x} + F$$

**LOGRn** Logarithm

$$A \times \ln\left(\frac{Bx + C}{Dx + E}\right) + F$$

**EHPOn** Exponential

$$A \times e^{\left(\frac{Bx + C}{Dx + E}\right)} + F$$

**POWEr** Power

$$A \times (Bx + C)^{(Dx + E)} + F$$

**rOOt** Root

$$A \times \sqrt{\frac{Bx + C}{Dx + E}} + F$$

**S In H** Sin x

$$A \sin^5 x + B \sin^4 x + C \sin^3 x + D \sin^2 x + E \sin x + F$$

**COn.-** Setting constants for calculation of mat. functions

- this menu is displayed only after selection of given mathematic function

### 6.2.2b Mathematic functions - decimal point

↑	←			
↻	→	INPUTS	CHAR.n	MATH.F
↓				000000
		CHAR.nE	MATH.Fn	CO.n.A
				00000.0
		OUTPUT	PI.n.MATH	CO.n.b
				0000.00
		SERUI		CO.n.C
				000.0000
				CO.n.d
				00.00000
				CO.n.E
				0.000000
				CO.n.F
				FLOR.P
				<b>DEF</b>
				F0rN.n
				dESC.n
				SrUE.n
↑				

#### F0rN.n Selection of decimal point

- the instrument allows for classic projection of a number with positioning of the DP as well as projection with floating DP, allowing to display a number in its most exact form „FLOAT.P.“

000000	Setting DP - XXXXXX.
00000.0	Setting DP - XXXXX.x
0000.00	Setting DP - XXXX.xx
000.0000	Setting DP - XXX.xxx
00.00000	Setting DP - XX.xxxx
0.000000	Setting DP - X.xxxxx
FLOR.P	Floating DP

- **DEF**

### 6.2.2c Mathematic functions - measuring units


↑	←			
↻	→	INPUTS	CHAR.n	MATH.F
↓				
		CHAR.nE	MATH.Fn	CO.n.A
		OUTPUT	PI.n.MATH	CO.n.b
		SERUI		CO.n.C
				CO.n.d
				CO.n.E
				CO.n.F
				F0rN.n
				dESC.n
				SrUE.n
↑				

#### dESC.n Setting projection of description for "MAT.FN"

- projection of measured data may be extended (at the expense of the number of displayed places) by two characters for description
- description is set by shifted ASCII code, when two first places show the set description and two last characters their code in period 0...95
- description is cancelled by code 00

- **DEF** - no description


**!**  
Table of signs on page 83

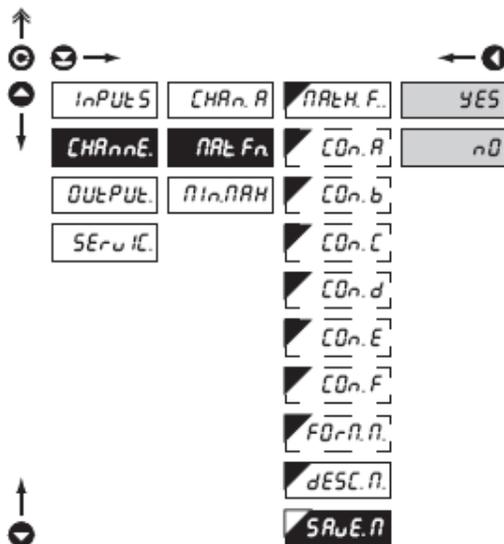6.2.2d **Mathematic functions - selection of storing data into Instrument memory****SAV.E.A** Selection of storing data into Instrument memory

- by selection in this item you allow to register values into instrument memory
- another setting in item "OUTPUT > MEMORY" (not in standard experiment)

YES Measured data are stored in the memory

nD Measured data are not stored

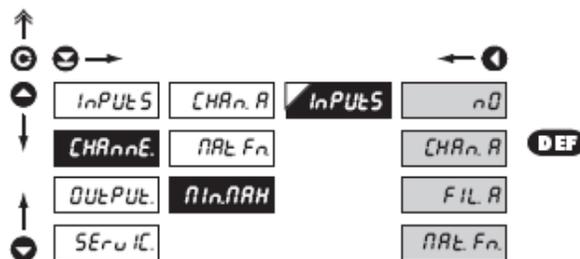6.2.3 **Selection of evaluation of min/max value****InPUtS** Selection of evaluation of min/max value

- selection of value from which the min/max value will be calculated


nD Evaluation of min/max value is off

CHAn.A From "Channel A"

FIL.A From "Channel A" after digital filters processing

MAth.Fn From "Mathematic functions"


### 6.3 Setting „PROFI“ - OUTPUTS

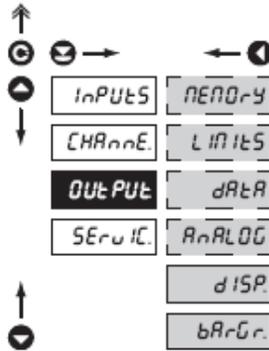

In this menu it is possible to set parameters of the instrument output signals

- nENDrY Setting data logging into memory
- LImItS Setting type and parameters of limits
- dAtA Setting type and parameters of data output
- AnALOG Setting type and parameters of analog output
- dISP Setting display projection and brightness
- bARGr Setting bargraph projection and brightness


#### 6.3.1a Selection of mode of data logging into instrument memory

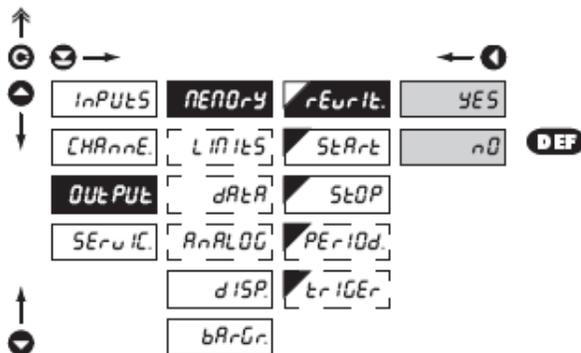

**rEurIt.** Selection of the mode of data logging

- selection of the mode in the event of full instrument memory
- nD Rewriting values prohibited
- YES Rewriting values permitted, the oldest get rewritten by the latest

## 6.3.1b Setting data logging into Instrument memory - RTC

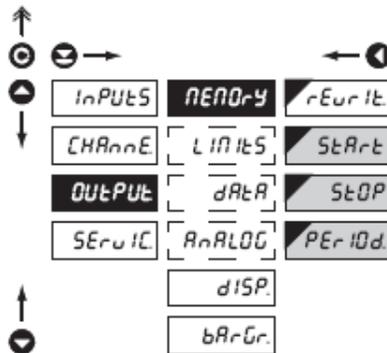

**StArt** Start of data logging into instrument memory

- time format HH.MM.SS


**StOP** Stop data logging into instrument memory

- time format HH.MM.SS

**PErIOD** Period of data logging into instrument memory

- determines the period in which values will be logged in an interval delimited by the time set under items START and STOP
- time data hold valid for one day, where the logging is valid for every day without limitation
- time format HH.MM.SS
- item not displayed if "STORE" is selected in menu (Input > AUX. IN.)

## 6.3.1c Setting data logging into Instrument memory - FAST

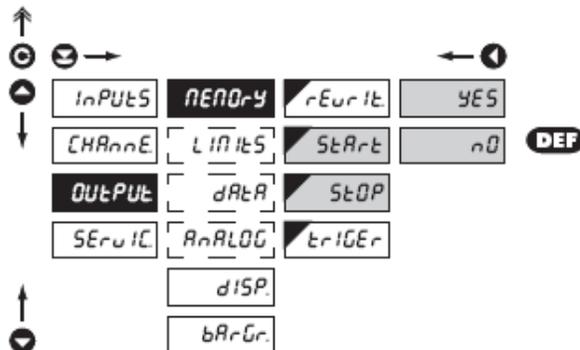

**StArt** Start of data logging into instrument memory

**StOP** Stop data logging into instrument memory

- time format HH.MM.SS

**tRIGEr** Setting logging data into inst. memory


- values will be logged in an interval delimited by the time set under items START and STOP, time data hold valid for one day, where the logging is valid for every day without limitation
- logging data into inst. memory is governed by the following selection, which determines how many percent of the memory is reserved for data logging prior to initiation of trigger impulse
- initiation is on ext. input or control key

**10%** Reser. of 10 % memory prior init. of data logging

**50%** Reser. of 50 % memory prior init. of data logging

**90%** Reser. of 90 % memory prior init. of data logging

**rOLL** After initiation of data logging the memory is cyclically transcribed

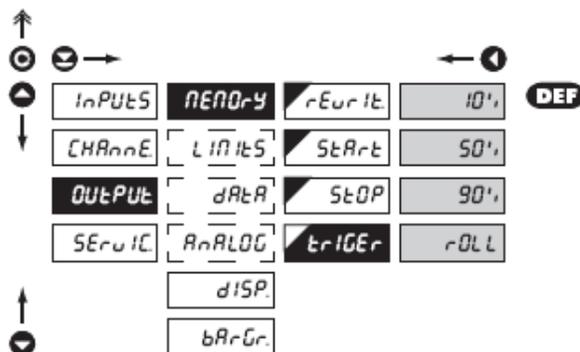

#### 6.3.2a Selection of Input for limits evaluation

INPUTS	ANALOG	LIM 1	InP.L1	n0
CHANNEL	LIMITS	LIM 2	NOd.L1	CHAn.A
OUTPUT	dAtA	LIM 3	tYP.L1	FIL.A
SERVIC	ANALOG	LIM 4	LIM.L1	MAt.Fn
	DISP		HYS.L1	Min
	BARGr		On.L1	MAx
			OFF.L1	
			PER.L1	
			tIM.L1	

#### InP.L1 Selection evaluation of limits

- selection of value from which the limit will be evaluated

- n0** Limit evaluation is off
- CHAn.A** Limit evaluation from "Channel A"
- FIL.A** Limit evaluation from "Channel A" after digital filters processing
- MAt.Fn** Limit evaluation from "Mathematic functions"
- Min** Limit evaluation from "Min.value"
- MAx** Limit evaluation from "Max.value"

! Setting is identical for LIM 2, LIM 3 and LIM 4

#### 6.3.2b Selection of type of limit


INPUTS	ANALOG	LIM 1	InP.L1	HYS tEr
CHANNEL	LIMITS	LIM 2	NOd.L1	FrOn
OUTPUT	dAtA	LIM 3	tYP.L1	dOS InG
SERVIC	ANALOG	LIM 4	LIM.L1	
	DISP		HYS.L1	
	BARGr		On.L1	
			OFF.L1	
			PER.L1	
			tIM.L1	

#### NOd.L1 Selection the type of limit

- HYS tEr** Limit is in mode "Limit, hysteresis, delay"
  - for this mode the parameters of "LIM. L." are set, at which the limit will shall react, "HYS. L." the hysteresis range around the limit ( $LIM \pm 1/2 HYS$ ) and time "TIM. L." determining the delay of relay switch-on
- FrOn** Frame limit
  - for this mode the parameters are set for interval "ON. L." the relay switch-on and "OFF. L." the relay switch-off
- dOS InG** Dose limit (periodic)
  - for this mode the parameters are set for "PER. L." determining the limit value as well as its multiples at which the output is active and "TIM. L." indicating the time during which is the output active

! Setting is identical for LIM 2, LIM 3 and LIM 4

## 6.3.2c Selection of type of output

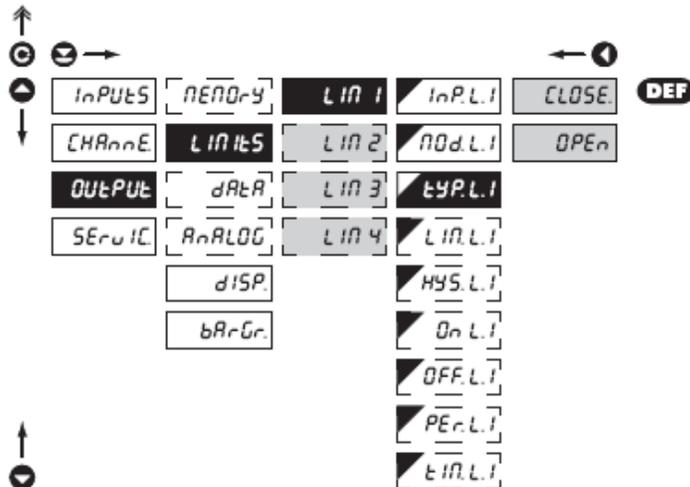

**TYP.L.1** Selection of type of output

**CLOSE** Output switches on when condition is met

**OPEn** Output switches off when condition is met

! Setting is identical for LIM 2, LIM 3 and LIM 4

## 6.3.2d Setting values for limits evaluation

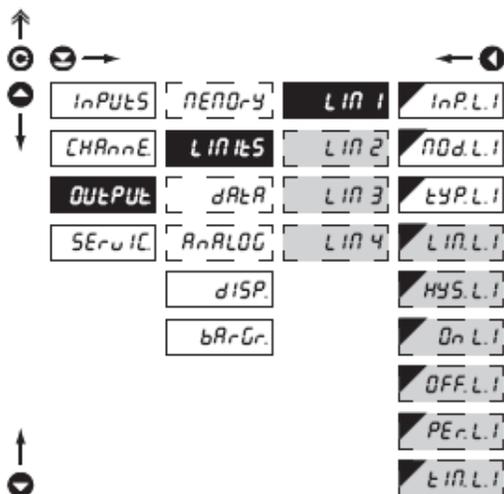
**LIM.L.1** Setting limit for switch-on

- for type "HYSTER"

**HYS.L.1** Setting hysteresis

- for type "HYSTER"
- indicates the range around the limit (in both directions, LIM.  $\pm 1/2$  HYS.)

**On.L.1** Setting the outset of the interval of limit switch-on

- for type "FROM"

**OFF.L.1** Setting the end of the interval of limit switch-on

- for type "FROM"

**PER.L.1** Setting the period of limit switch-on

- for type "DOSE"

**tIN.L.1** Setting the time switch-on of the limit

- for type "HYSTER" and "DOSE"

! Setting is identical for LIM 2, LIM 3 and LIM 4

6.3.3a Selection of data output baud rate

The screenshot shows a menu with several options. The 'bAUD' option is highlighted with a black background and white text. To its right, the value '600' is displayed. A 'DEF' label is positioned to the right of the menu.

↑	⊙	→		←	Ⓛ
↑	⊙	→	InPUtS	NEtWOrk	bAUD 600
↓	⊙	→	CHAnnE	LIInItS	Addr. 1200
	⊙	→	OUtPUt	dAtA	PrOt. 2400
	⊙	→	SErUIC	ANALOG	4800
				dISP.	9600
				bARGr.	19200
					38400
					57600
					115200
↓					

**bAUD** Selection of data output baud rate

---

600	Rate - 600 Baud
1200	Rate - 1 200 Baud
2400	Rate - 2 400 Baud
4800	Rate - 4 800 Baud
9600	Rate - 9 600 Baud
19200	Rate - 19 200 Baud
38400	Rate - 38 400 Baud
57600	Rate - 57 600 Baud
115200	Rate - 115 200 Baud

6.3.3b Setting instrument address

The screenshot shows the same menu as in 6.3.3a, but with the 'Addr.' option highlighted. The value '00' is not yet visible, but the 'DEF' label is present.


↑	⊙	→		←	Ⓛ
↑	⊙	→	InPUtS	NEtWOrk	bAUD
↓	⊙	→	CHAnnE	LIInItS	Addr.
	⊙	→	OUtPUt	dAtA	PrOt.
	⊙	→	SErUIC	ANALOG	
				dISP.	
				bARGr.	
↓					

**Addr.** Setting instrument address

---

- setting in range 0...31
- **DEF** - 00


## 6.3.3c Selection of data output protocol

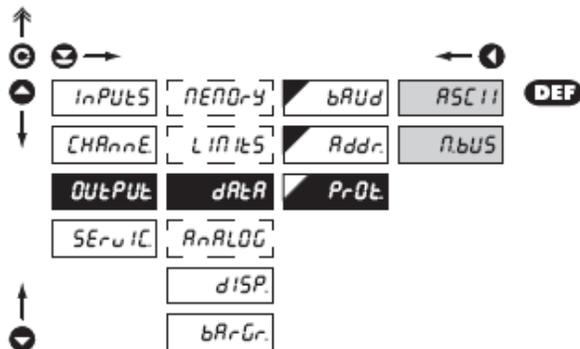
**PrOt** Selection of the type of analog output

**ASCII** Data protocol ASCII

**n.bUS** Data protocol DIN MessBus

## 6.3.4a Selection of input for analog output

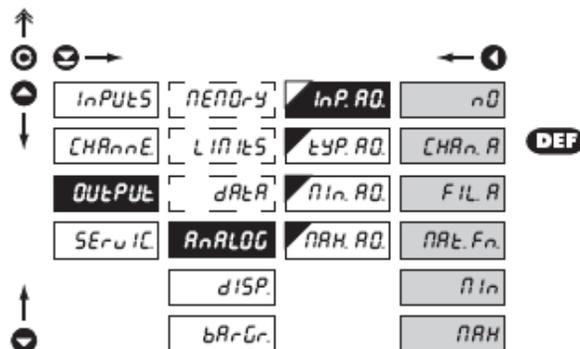
**InP.AO** Selection evaluation analog output

- selection of value from which the analog output will be evaluated

**nD** AO evaluation is off

**CHAnnA** AO evaluation from "Channel A"


**FILA** AO evaluation from "Channel A" after digital filters processing

**nAt.Fn** AO evaluation from "Math.functions"

**nIn** AO evaluation from "Min.value"

**nAn** AO evaluation from "Max.value"


### 6.3.4b Selection of the type of analog output

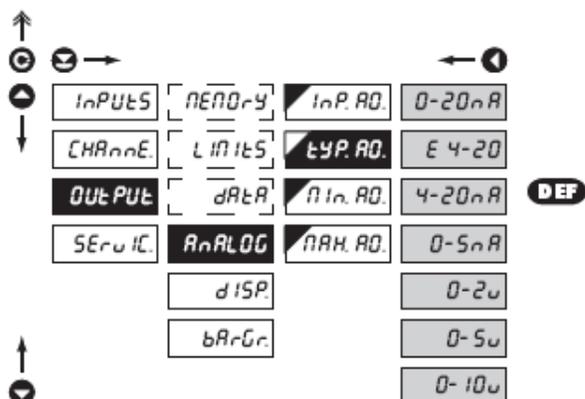

#### tYP. AO Selection of the type of analog output

- 0-20mA** Type - 0...20 mA
- E 4-20** Type - 4...20 mA
  - with indication of error statement (< 3,0 mA)
- 4-20mA** Type - 4...20 mA
- 0-5mA** Type - 0...5 mA
- 0-2V** Type - 0...2 V
- 0-5V** Type - 0...5 V
- 0-10V** Type - 0...10 V

### 6.3.4c Setting the analog output range

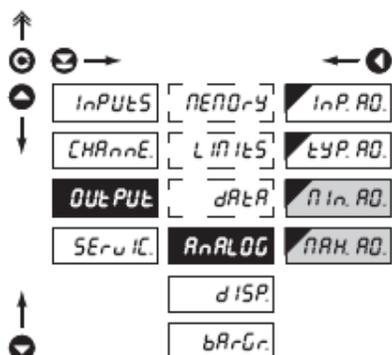


#### AnALOG Setting the analog output range

- analog output is isolated and its value corresponds with displayed data. It is fully programmable, i.e. it allows to assign the AO limit points to two arbitrary points of the entire measuring range

**nIn. AO** Assigning the display value to the beginning of the AO range  
 - range of the setting is -99999...999999  
 - **DEF** - 0

**nAR. AO** Assigning the display value to the end of the AO range  
 - range of the setting is -99999...999999  
 - **DEF** - 100


## 6.3.5a Selection of input for display projection

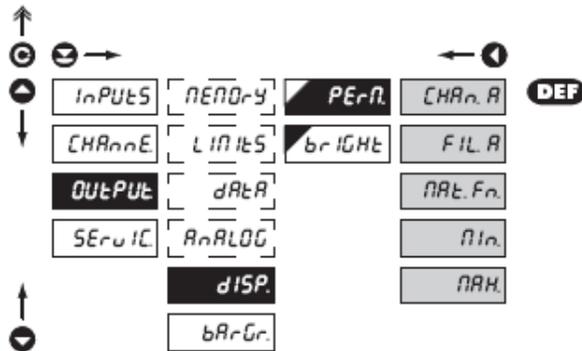
**InPUtS** Selection display projection

- selection of value which will be shown on the instrument display

- CHAN.A Projection of values from "Channel A"
- FIL.A Projection of values from "Channel A" after digital filters processing
- MAt.Fn Projection of values from "Math.functions"
- Min Projection of values from "Min.value"
- MAx Projection of values from "Max.value"


## 6.3.5b Selection of display brightness

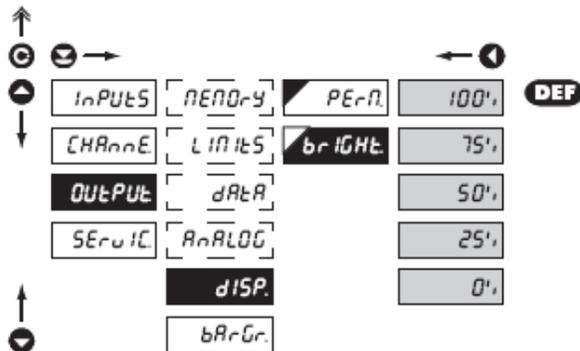
**brIGHt** Selection of display brightness

- by selecting display brightness we may appropriately react to light conditions in place of instrument location

- 0% Display is off
- after keystroke display turns on for 10 s
- 25% Display brightness - 25%
- 50% Display brightness - 50%
- 75% Display brightness - 75%
- 100% Display brightness - 100%

#### 6.3.6a Bargraph - Selection of projection Input

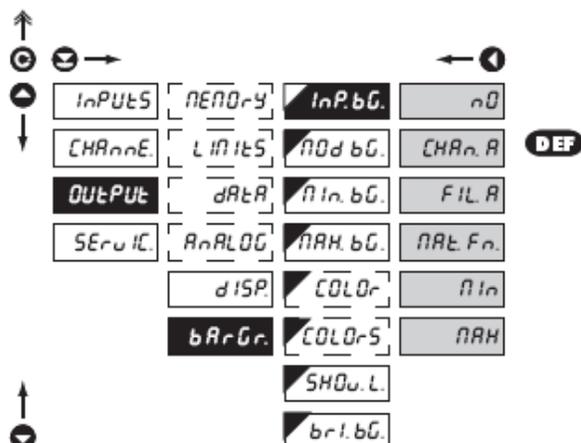


#### InP.bG. Selection of bargraph evaluation

- selection of value from which the analog output will be evaluated

- nD Analog evaluation is off
- CHANN.A From "Channel A"
- FIL.A From "Channel A" after digital filter modification
- MAT.Fcn. From "Mathematic function"
- Min From "Minimum value"
- MAX From "Maximum value"


#### 6.3.6b Bargraph - Selection of projection mode

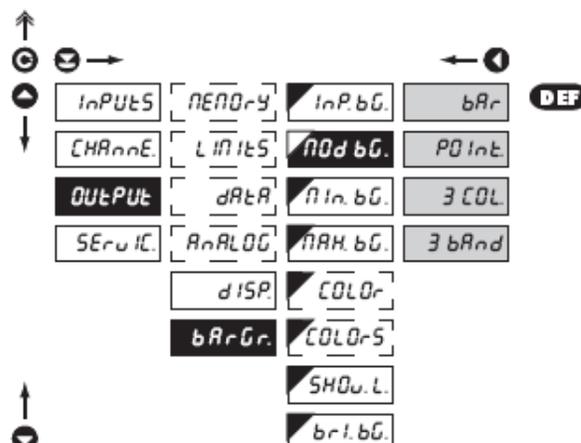

#### NOd.bG. Selection of bargraph projection mode

- bAr Column projection
  - the display shows only a column in one color
- POInE Point projection
  - the display shows one point in one color
- 3COL 3-colored column projection
  - change of color is determined by set limits (COLORS > BAND)
  - upon exceeding the limit the color of the entire display, i.e. there is always only one column of one color lit
- 3bARnd 3-colored bar projection, cascade
  - change of color is determined by the said limits (COLORS > BAND)
  - upon exceeding a limit color of the given display section is changing, i.e. the display may shine up to three colors at a time

## 6.3.6c Bargraph - Setting the projection range

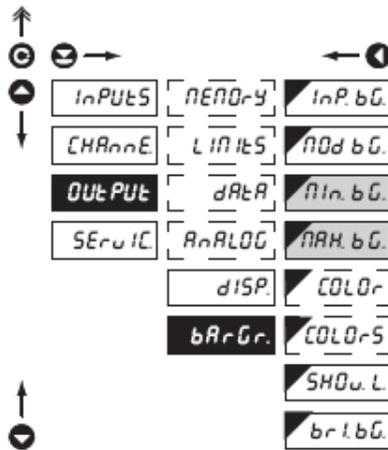**bARGr.** Setting the bargraph projection range

- setting is the same as the setting for main display projection


**Min. bG.** Setting bargraph projection for minimum input signal value

- range of the setting is -99999...999999
- **DEF** - 0

**MAX. bG.** Setting bargraph projection for maximum input signal value

- range of the setting is -99999...999999
- **DEF** - 100


## 6.3.6d Bargraph - Setting color

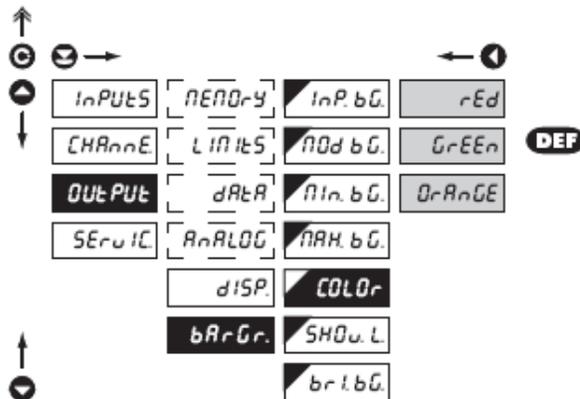**COLOr** Selection of bargraph color

- the item "COLOR" is displayed only with selected mode ("BARGR. > MOD. BG.") "BAR." or "POINT."

**rEd** Red color**GrEEEn** Green color**OrAnGE** Orange color

#### 6.3.6e Bargraph - Color setting

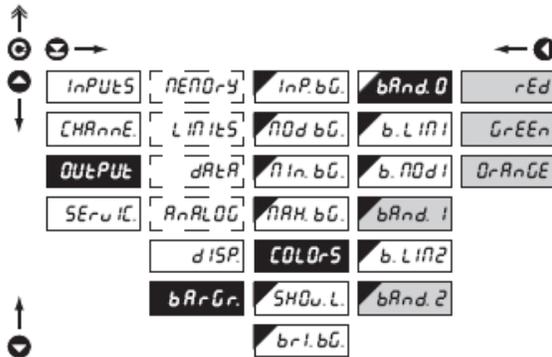

#### **bAnd.0** Selection of bargraph color


- the item "COLORS" is displayed only with selected mode ("BARGR. > MOD. BG.") "3 COL." or "3 BAND"

- rEd** Red color
- GrEEen** Green color
- OrAnGE** Orange color

- **DEF** - Green (Band 0)
- **DEF** - Orange (Band 1)
- **DEF** - Red (Band 2)

Setting is identical for BAND. 1 and BAND. 2

#### 6.3.6f Bargraph - Setting the color changes bands

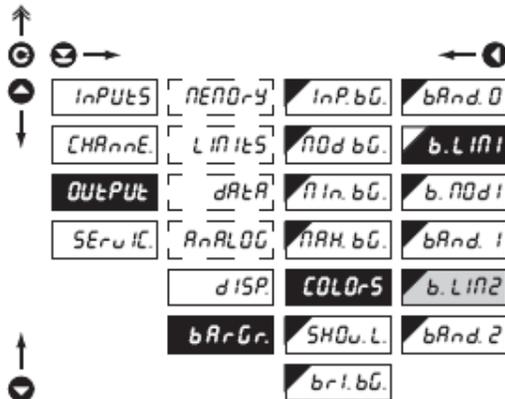

#### **b.LIM1** Setting color limits for color projection


- the item "COLORS" is displayed only with selected mode ("BARGR. > MOD. BG.") "3 COL." or "3 BAND."  
 - items „b. LIM 1" and „b. LIM 2" determine the borders of the bargraph color changes

- b.LIM1** Boundary between bands 0 - 1
- b.LIM2** Boundary between bands 1 - 2

- **DEF** - 33 (b. LIM 1)
- **DEF** - 66 (b. LIM 2)

Setting is identical for B. LIM 2

## 6.3.6g Bargraph - Selection of Inverse projection

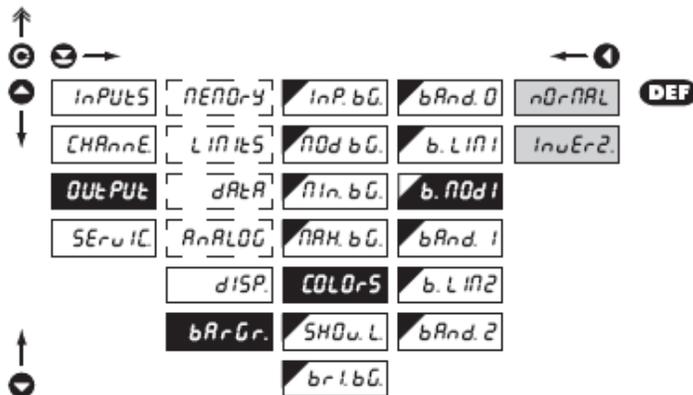
**b.MOD1** Selection of Inverse projection of "Band 0"

- the item "COLORS" is displayed only with selected mode ("BARGR. > MOD. BG.") "3 COL." or "3 BAND."
- setting „b. MOD 1“ is designed for projection where indication of zero center is required

nOrNRL Column in "BAND 0" moves from left to right

InuEr2. Column in "BAND 0" moves from right to left

## 6.3.6h Bargraph - Selection of limits projection

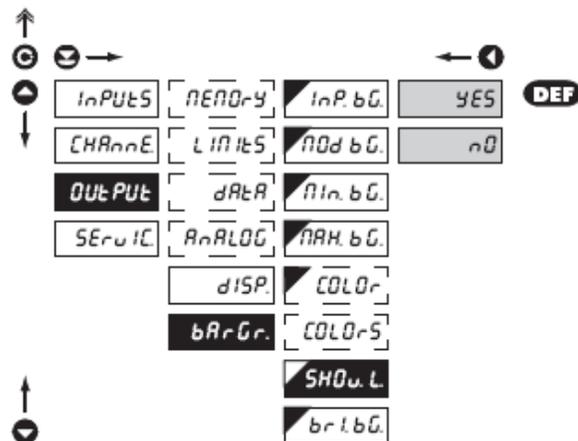
**SHOU.L** Selection of limit projection on the bargraph

- limits are always displayed orange, always by one degree lighter or darker

YES Limits are projected

n0 Limits are not projected

## 6.3.6i Bargraph - Selection of display brightness

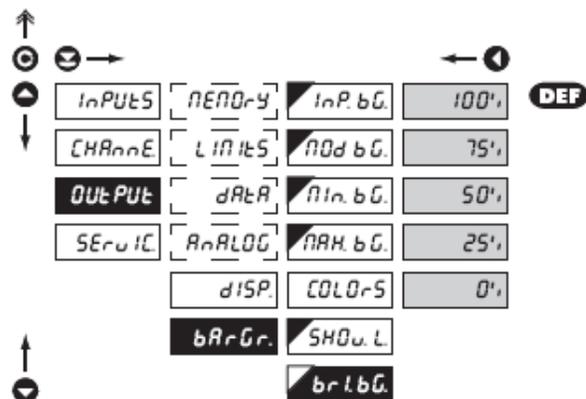**brI. bG.** Selection of bargraph brightness

- Bargraph is off
- after pres. the key the display lights up for 0 s


25% Brightness - 25%

50% Brightness - 50%

75% Brightness - 75%

100% Brightness - 100%


#### 6.4 Setting "PROFI" - SERVIS

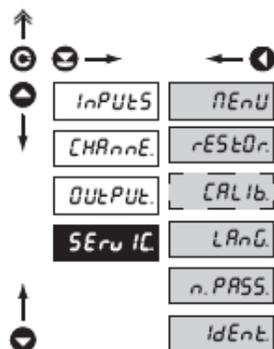

The instrument service functions are set in this menu

- nEnU** Selection of menu type LIGHT/PROFI
- rEStOr.** Restore instrument manufacture setting and calibration
- CALib.** Input range calibration for „DU“ version
- LAnG.** Language version of instrument menu
- n.PASS.** Setting new access password
- IdEnt.** Instrument identification

#### 6.4.1 Selection of type of programming menu

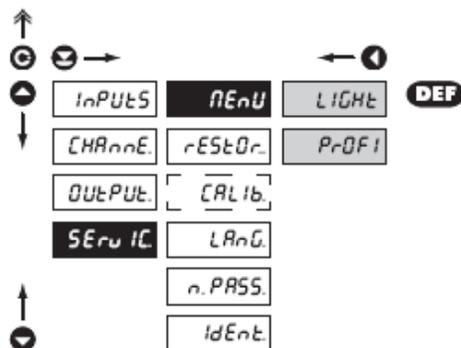

**nEnU** Selection of menu type - LIGHT/PROFI

- enables setting the menu complexity according to user needs and skills

**LIGHt** Active LIGHT menu

- simple programming menu, contains only items necessary for configuration and instrument setting
- linear menu > items one after another


**PrOFI** Active PROFI menu

- complete programming menu for expert users
- tree menu



Change of setting is valid upon next access into menu

## 6.4.2 Restoration of manufacture setting

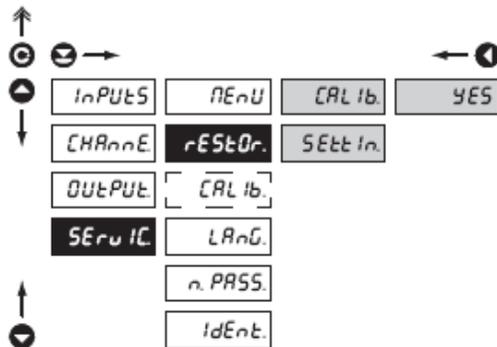
**rEStOr.** Restoring manufacture setting of the instrument

- in the event of erroneous setting or calibration it is feasible to restore manufacture setting. Prior execution of any changes you will be asked to confirm your preference „YES“

**CAL Ib.** Restore manufacture instrument calibration


**SEtEt In.** Restore manufacture instrument setting

- loading manufacture setting (items denoted DEF)
- prior execution of changes you will be asked to confirm your preference “YES“

Jobs performed	Restore	
	Calibration	Setting
cancelS USER menu rights	✓	✓
deletes table of items order in USER - LIGHT menu	✓	✓
adds items from manufacture to LIGHT menu	✓	✓
deletes data stored in FLASH	✓	✓
cancelS or linearization tables	✓	✓
clearS tare	✓	✓
clearS conduct resistances	✓	✓
restore manufacture calibration	✓	✗
restore manufacture setting	✗	✓

#### 6.4.3 Calibration - Input range


**DU**

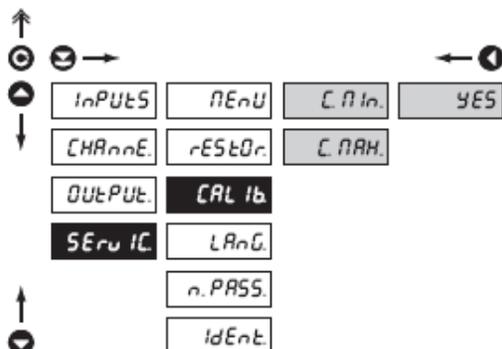

#### **CAL Ib.** Input range calibration

- when "C. MIN." is displayed, move the potentiometer traveller to the required minimum position and confirm by „Enter”, calibration is confirmed by "YES"
- when "C. MAX." is displayed, move the potentiometer traveller to required maximum position and confirm by „Enter”, calibration is confirmed by „YES"


#### 6.4.4 Selection of Instrument menu language version

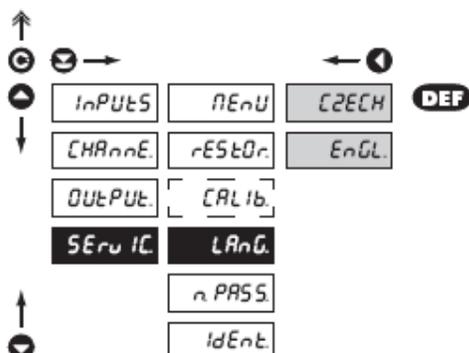

#### **LAnG.** Selection of Instrument menu language version


- CZECH** Instrument menu is in Czech
- EnGL.** Instrument menu is in English

#### 6.4.5 Setting new access password

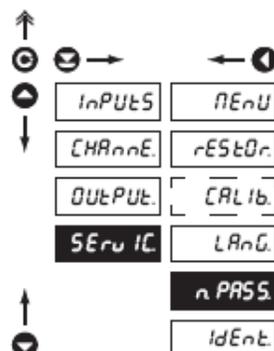

#### **n.PASS.** Setting new password for access to LIGHT and PROFi menu

- this selection enables changing number code that blocks the access into LIGHT and PROFi Menu.
- range of the number code is 0...9999
- universal password in the event of loss is „8177"

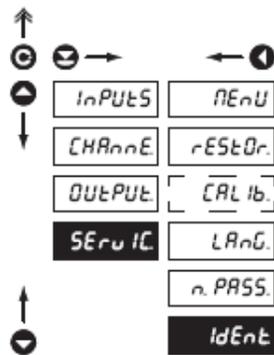**IdEnt.**

## Projection of Instrument SW version

- display shows type identification of the instrument, SW number, SW version and current input setting (Mode)
- if the SW version reads a letter on first position, it is a customer SW

## 7.0 Setting items into "USER" menu

- **USER** menu is designed for users who need to change only several items of the setting without the option to change the primary instrument setting (e.g. repeated change of limit setting)
- there are no items from manufacture permitted in **USER** menu
- on items indicated by inverse triangle 
- setting may be performed in **LIGHT** or **PROFI** menu, with the **USER** menu then overtaking the given menu structure



## Setting



-  **n0** item will not be displayed in **USER** menu
-  **YES** item will be displayed in **USER** menu with editing option
-  **SH0u** item will be solely displayed in **USER** menu

**Setting sequence of items in "USER" menu**

In compiling USER menu from active LIGHT menu the items (max. 10) may be assigned a sequence, in which they will be projected in the menu

*Example:*

Into USER menu were selected these items


(keys + ) > CL TAR., LIM 1, LIM 2, LIM 3, for which we have preset this sequence (keys + ):

CL TAR.	5
LIM 1	0 (sequence not determined)
LIM 2	2
LIM 3	1

Upon entering USER menu

(key ) items will be projected in the following sequence: LIM 3 > LIM 2 > CLTAR. > LIM 1

Instrument with input for temperature measurement with thermocouple allows to set two types of measurement of cold junction.

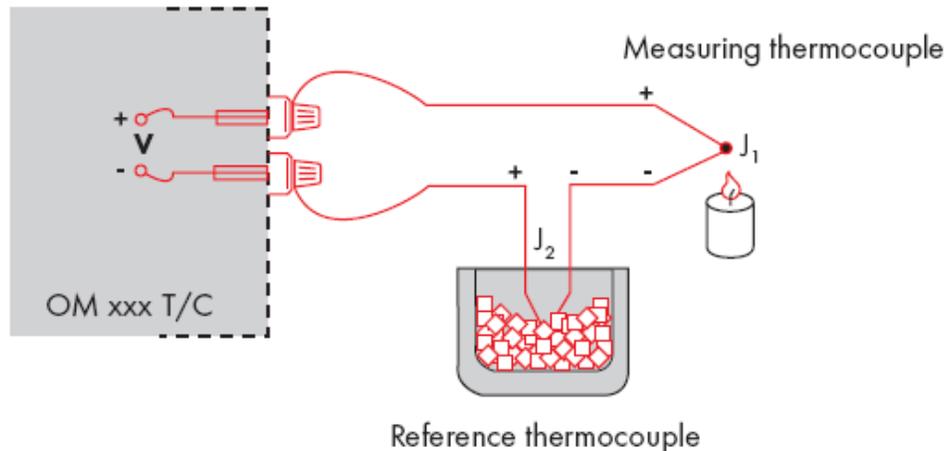

#### WITH REFERENCE THERMOCOUPLE

- a reference thermocouple may be located in the same place as the measuring instrument or in place with stable temperature/compensation box
- when measuring with reference thermocouple set *CONECT* in the instrument menu to *INT2TC* or *EHT2TC*
- when using a thermostat (a compensation box or environment with constant temperature) set in the instrument menu *CUCTERN* its temperature (applies for setting *CONECT* to *EHT2TC*)
- if the reference thermocouple is located in the same environment as the measuring instrument then set in the instrument menu *CONECT* to *INT2TC*. Based on this selection the measurement of the ambient temperature is performed by a sensor located in the instrument terminal board.

#### WITHOUT REFERENCE THERMOCOUPLE

- inaccuracy originating from the creation of dissimilar thermocouples on the transition point terminal/conductor of the thermocouple is not compensated for in the instrument
- when measuring without reference thermocouple set *CONECT* in the instrument menu to *INT1TC* or *EHT1TC*
- when measuring temperature without reference thermocouple the error in measured data may be as much as 10°C (applies for setting *CONECT* to *EHT1TC*)

The instruments communicate via serial line RS232 or RS485. For communication they use the ASCII protocol. Communication runs in the following format:

ASCII: 8 bit, no parity, one stop bit  
 DIN MessBus: 7 bit, even parity, one stop bit

The transfer rate is adjustable in the instrument menu. The instrument address is set in the instrument menu in the range of 0 ÷ 31. The manufacture setting always presets the ASCII protocol, rate of 9600 Baud, address 00. The type of line used - RS232 / RS485 - is determined by an output board automatically identified by the instrument. The commands are described in specification you can find at [www.orbit.merret.cz/rs](http://www.orbit.merret.cz/rs).

### DETAILED DESCRIPTION OF COMMUNICATION VIA SERIAL LINE

Activity	Data transferred										
Data solicitation (PC)	#	A	A	<CR>							
Data transmission (Instrument)	>	R	<SP>	D	D	D	D	D	(D)	(D)	<CR>
Command confirm. (Instr.) - OK	!	A	A	<CR>							
Command confirm. (Instr.) - Bad	?	A	A	<CR>							
Instrument identification	#	A	A	1Y	<CR>						
HW identification	#	A	A	1Z	<CR>						
One-time measurement	#	A	A	7X	<CR>						
Repeated measurement	#	A	A	8X	<CR>						

### LEGEND

#	35	23 <sub>H</sub>	Command beginning
A	A	0...31	Two signs of instrument address (sent in ASCII - tens and ones, e.g. "01", "99" universal)
<CR>	13	0D <sub>H</sub>	Carriage return
<SP>	32	20 <sub>H</sub>	Space
D			Data - usually signs "0"..."9", "-", ".", ";"; (D) - DP, and (-) may prolong data
R	50 <sub>H</sub> ...	57 <sub>H</sub>	Relay and Tare status
!	33	21 <sub>H</sub>	Positive command confirmation (ok)
?	63	3F <sub>H</sub>	Negative command confirmation (bad)
>	62	3E <sub>H</sub>	Beginning of the data transmitted

### RELAY, TARE

Sign	Relay 1	Relay 2	Tare	Change relay 3/4
P	0	0	0	0
Q	1	0	0	0
R	0	1	0	0
S	1	1	0	0
T	0	0	1	0
U	1	0	1	0
V	0	1	1	0
W	1	1	1	0
p	0	0	0	1
q	1	0	0	1
r	0	1	0	1
s	1	1	0	1
t	0	0	1	1
u	1	0	1	1
v	0	1	1	1
w	1	1	1	1

ERROR	CAUSE	ELIMINATION
<i>E. d. Un</i>	Number is too small (large negative) to be displayed	change DP setting, channel constant setting
<i>E. d. Ou</i>	Number is too large to be displayed	change DP setting, channel constant setting
<i>E. t. Un</i>	Number is outside the table range	increase table values, change input setting (channel constant setting)
<i>E. t. Ou</i>	Number is outside the table range	increase table values, change input setting (channel constant setting)
<i>E. i. Un</i>	Input quantity is smaller than permitted input quantity range	change input signal value or input (range) setting
<i>E. i. Ou</i>	Input quantity is larger than permitted input quantity range	change input signal value or input (range) setting
<i>E. Hu</i>	A part of the instrument does not work properly	send the instrument for repair
<i>E. EE</i>	Data in EEPROM corrupted	perform restoration of manufacture setting, upon repeated error statement send instrument for repair
<i>E. dAtA</i>	Data in EEPROM outside the range	perform restoration of manufacture setting, upon repeated error statement send instrument for repair
<i>E. CLR</i>	Memory was empty (presetting carried out)	upon repeated error statement send instrument for repair, possible failure in calibration

The instrument allows to add two descriptive characters to the classic numeric formats (at the expense of the number of displayed places). The setting is performed by means of a shifted ASCII code. Upon modification the first two places display the entered characters and the last two places the code of the relevant symbol from 0 to 95. Numeric value of given character equals the sum of the numbers on both axes of the table.

Description is cancelled by entering characters with code 00

	0	1	2	3	4	5	6	7		0	1	2	3	4	5	6	7
0		l	"	¥	5	'	¢	'	0		"	#	\$	%	&	'	
8	[	]	H	+	,	-		ˆ	8	(	)	*	+	,	-	.	/
16	0	1	2	3	4	5	6	7	16	0	1	2	3	4	5	6	7
24	B	9	=	.	c	=	o	ˆ	24	8	9	:	;	<	=	>	¿
32	]R	b	[	d	E	F	G		32	@	A	B	C	D	E	F	G
40	H	I	J	K	L	M	N	O	40	H	I	J	K	L	M	N	O
48	P	Q	R	S	T	U	V	W	48	P	Q	R	S	T	U	V	W
56	H	Y	Z	[	\	]	^	_	56	X	Y	Z	[	\	]	^	_
64	'	R	b	c	d	E	F	G	64	`	a	b	c	d	e	f	g
72	h	i	j	k	l	m	n	o	72	h	i	j	k	l	m	n	o
80	P	Q	R	S	T	U	V	W	80	p	q	r	s	t	u	v	w
88	H	Y	Z	[	\	]	^	_	88	x	y	z	{		}	~	

**INPUT**

range is adjustable			<b>DC</b>
	±60 mV	> 100 MΩ	Input U
	±150 mV	> 100 MΩ	Input U
	±300 mV	> 100 MΩ	Input U
	±1200 mV	> 100 MΩ	Input U

range is adjustable			<b>PM</b>
	0/4...20 mA	< 400 mV	Input I
	±2 V	1 MΩ	Input U
	±5 V	1 MΩ	Input U
	±10 V	1 MΩ	Input U
	±40 V	1 MΩ	Input U

range is adjustable			<b>OHM</b>
	0...100 Ω		
	0...1 kΩ		
	0...10 kΩ		
	0...100 kΩ		
Connection:	2, 3 or 4 wire		

			<b>RTD</b>
Pt xxxx	-200°...850°C		
Ni xxxx	-30,0°...199,9°C		
Type Pt:	100/500/1 000 Ω, s 3850 ppm/°C		
	100 Ω, s 3920 ppm/°C		
Type Ni:	Ni 1 000/ Ni 10 000 s 5000/6180 ppm/°C		
Connection:	2, 3 or 4 wire		

range is adjustable in configuration menu			<b>T/C</b>
Type:	J (Fe-CuNi)	-200°...900°C	
	K (NiCr-Ni)	-200°...1 300°C	
	T (Cu-CuNi)	-200°...400°C	
	E (NiCr-CuNi)	-200°...690°C	
	B (PtRh30-PtRh6)	300°...1 820°C	
	S (PtRh10-Pt)	-50°...1 760°C	
	R (Pt13Rh-Pt)	-50°...1 740°C	
	N (Omegalloy)	-200°...1 300°C	

Voltage of lin. pot.	2,5 VDC/6 mA		<b>DU</b>
	min. potentiometer resistance is 500 Ω		

**PROJECTION**

Display 1:	30-segment 3-color bargraph
Display2:	auxiliary 6-digit display, intensive red or green, 7-segment LED, letter height 9,1 mm
Projection:	30 LED/-99999...999999
Decimal point:	adjustable - in menu
Brightness:	adjustable - in menu

**INSTRUMENT ACCURACY**

TC:	100 ppm/°C	
Accuracy:	±0,1 % of range + 1 digit	
	±0,15 % of range + 1 digit	<b>RTD, T/C</b>
	±0,3 % of range + 1 digit	<b>PWR</b>
	<b>Above accuracies apply for projection 9999</b>	
Resolution:	0,01°/0,1°/1°	<b>RTD</b>
Rate:	0,1...40 measurements/s	
Overload capacity:	10x (t < 100 ms) not for 400 V and 5 A, 2x (long-term)	
Linearisation:	by linear interpolation in 50 points - solely via OM Link	
Digital filters:	Averaging, Floating average, Exponential filter, Rounding	
Comp. of conduct:	max. 40 Ω/100 Ω	<b>RTD</b>
Comp. of cold junct.:	adjustable	<b>T/C</b>
	0°...99°C or automatic	
Functions:	Tare - display resetting Hold - stop measuring (at contact) Lock - control key locking MM - min/max value Mathematic functions	
OM Link:	company communication interface for setting, operation and update of instrument SW	
Watch-dog:	reset after 400 ms	
Calibration:	at 25°C and 40% of r.h.	

**COMPARATOR**

Type:	digital, adjustable in menu
Mode:	Hysteresis, From, Dose
Limits:	-99999...999999
Hysteresis:	0...999999
Delay:	0...99,9 s
Outputs:	2x relays with switch-on contact (Form A) (230 VAC/30 VDC, 3 A)* 2x relays with switch-off contact (Form C) (230 VAC/50 VDC, 3 A)*
Relay:	1/8 HP 277 VAC, 1/10 HP 125 V, Pilot Duty D300

**DATA OUTPUTS**

Protocols:	ASCII, DIN MessBus
Data format:	8 bit + no parity + 1 stop bit (ASCII) 7 bit + even parity + 1 stop bit (MessBus)
Rate:	600...115 200 Baud

\* values apply for resistance load

RS 232:	isolated, two-way communication
RS 485:	isolated, two-way communication, addressing (max. 31 instruments)
PROFIBUS	Data protocol SIEMENS

#### ANALOGO OUTPUTS

Type:	isolated, programmable with resolution of max. 10 000 points, analog output corresponds with displayed data, type and range are adjustable
Non-linearity:	0,2 % of range
TC:	100 ppm/°C
Rate:	response to change of value < 40 ms
Voltage:	0...2 V/5 V/10 V
Current:	0...5/20 mA/4...20 mA - compensation of conduct to 500 Ohm

#### MEASURED DATA RECORD

Type RTC:	time-controlled logging of measured data into instrument memory, allows to log up to 250 000 values
Type FAST:	fast data logging into instrument memory, allows to log up to 8 000 values at a rate of 40 records/s
Transmission:	via data output RS 232/485 or via OM Link

#### EXCITATION

Adjustable:	5...24 VDC/max. 1,2 W, isolated
-------------	---------------------------------

#### POWER SUPPLY

Options:	10...30 V AC/DC, 10 VA, isolated, - fuse inside (T 4000 mA) 80...250 V AC/DC, 10 VA, isolated - fuse inside (T 630 mA)
----------	---


#### MECHANIC PROPERTIES

Material:	Noryl GFN2 SE1, incombustible UL 94 V-I
Dimensions:	96 x 48 x 120 mm
Panel cut-out:	90,5 x 45 mm

#### OPERATING CONDITIONS



Connection:	connector terminal board, conductor cross-section <1,5 mm <sup>2</sup> / <2,5 mm <sup>2</sup>
Stabilisation period:	within 15 minutes after switch-on
Working temp.:	0°...60°C
Storage temp.:	-10°...85°C
Cover:	IP65 (front panel only)
Construction:	safety class I
Overvoltage category:	EN 61010-1, A2
Insulation resistance:	for pollution degree II, measurement category III AC instrum. power supply > 670 V (PI), 300 V (DI) DC instrum. power supply > 300 V (PI), 150 V (DI) Input/output > 300 V (PI), 150 (DI)
EMC:	EN 61000-3-2+A12; EN 61000-4-2, 3, 4, 5, 8, 11; EN 550222, A1, A2

PI - Primary insulation, DI - Double insulation

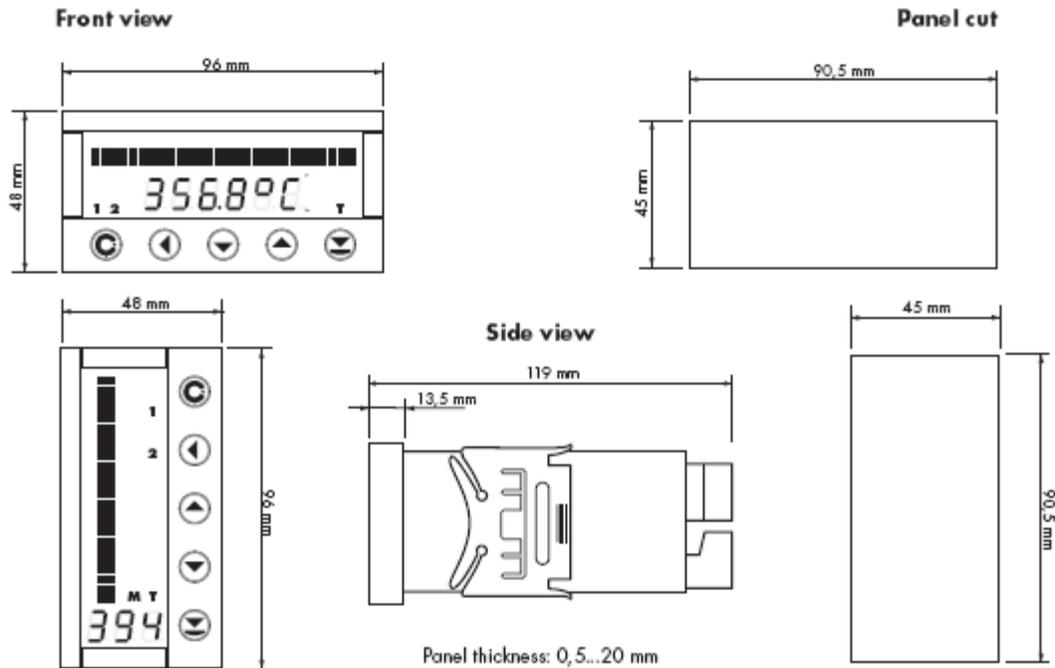

### Instrument installation

1. insert the instrument into the panel cut-out
2. fit both travellers on the box
3. press the travellers close to the panel

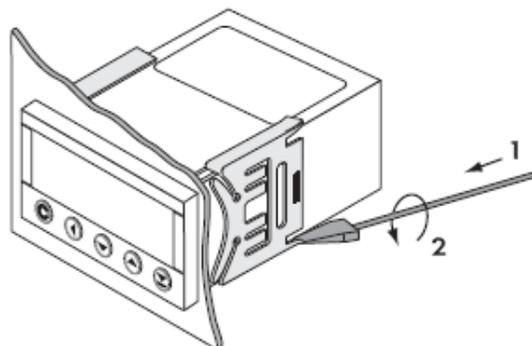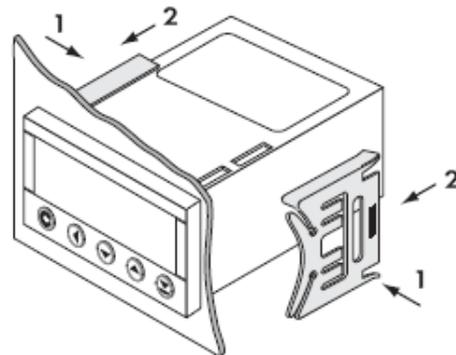

### Instrument disassembly

1. slide a screw driver under the traveller wing
2. turn the screw driver and remove the traveller
3. take the instrument out of the panel

# AM3030-WIRING-DIAGRAM

